
I-8123W/I-9123 CANopen Master Module

User's Manual

Warranty

All products manufactured by ICP DAS are warranted against defective materials for a period of one year from the date of delivery to the original purchaser.

Warning

ICP DAS assume no liability for damages consequent to the use of this product. ICP DAS reserves the right to change this manual at any time without notice. The information furnished by ICP DAS is believed to be accurate and reliable. However, no responsibility is assumed by ICP DAS for its use, nor for any infringements of patents or other rights of third parties resulting from its use.

Copyright

Copyright 2010 by ICP DAS. All rights are reserved.

Trademark

The names used for identification only maybe registered trademarks of their respective companies.

Tables of Content

1.	General Information.....	6
1.1.	CANopen Introduction.....	6
1.2.	CANopen Applications.....	7
1.3.	I-8123 Library Characteristics.....	8
2.	Hardware Specification.....	11
2.1.	Hardware Structure	11
2.2.	Wire Connection	14
2.3.	Power LED.....	15
2.4.	Tx/Rx LED.....	15
2.5.	ERR LED.....	15
3.	I-8123 Function Library.....	16
3.1.	Function List	16
3.2.	Function Return Code	19
3.3.	CANopen Master Library Application Flowchart.....	21
3.4.	Communication Services Introduction.....	23
3.5.	Function Description	26
3.5.1.	I8123_GetVersion.....	26
3.5.2.	I8123_SetFunctionTimeout	27
3.5.3.	I8123_GetCANStatus.....	28
3.5.4.	I8123_InitMaster	29
3.5.5.	I8123_ShutdownMaster	30
3.5.6.	I8123_MasterSendBootupMsg.....	31
3.5.7.	I8123_SetMasterMode	32
3.5.8.	I8123_GetMasterMode	33
3.5.9.	I8123_GetFirmwareVersion	34
3.5.10.	I8123_EDS_Load.....	35
3.5.11.	I8123_AddNode	37
3.5.12.	I8123_RemoveNode.....	39
3.5.13.	I8123_RemoveAndResetNode.....	40
3.5.14.	I8123_DelayAndResponseTimeout	41
3.5.15.	I8123_ScanNode.....	42

3.5.16.	I8123_GetNodeList.....	44
3.5.17.	I8123_NMTChangeState	45
3.5.18.	I8123_NMTGetState	46
3.5.19.	I8123_NMTGuarding.....	47
3.5.20.	I8123_NMTHeartbeat	49
3.5.21.	I8123_SDOReadData.....	51
3.5.22.	I8123_SDOReadFile	52
3.5.23.	I8123_SDOWriteData.....	53
3.5.24.	I8123_SDOAbortTransmit.....	55
3.5.25.	I8123_PDOWrite	56
3.5.26.	I8123_PDOWrite_Fast	57
3.5.27.	I8123_PDORemote	58
3.5.28.	I8123_PDORemote_Fast.....	59
3.5.29.	I8123_SetPDORemotePolling	60
3.5.30.	I8123_GetPDOLastData.....	61
3.5.31.	I8123_GetPDOLastData_Fast	62
3.5.32.	I8123_GetMultiPDOData	63
3.5.33.	I8123_GetMultiPDOData_Fast	64
3.5.34.	I8123_GetRxPDOID	65
3.5.35.	I8123_GetTxPDOID	66
3.5.36.	I8123_InstallPDO.....	67
3.5.37.	I8123_DynamicPDO	68
3.5.38.	I8123_RemovePDO	70
3.5.39.	I8123_ChangePDOID	71
3.5.40.	I8123_GetPDOMapInfo	72
3.5.41.	I8123_InstallPDO_List	73
3.5.42.	I8123_RemovePDO_List	75
3.5.43.	I8123_PDOWUseEntry.....	76
3.5.44.	I8123_PDOWTxType	77
3.5.45.	I8123_PDOWEventTimer.....	78
3.5.46.	I8123_PDOWInhibitTime	79
3.5.47.	I8123_ChangeSYNCCID	80
3.5.48.	I8123_SetSYNC_List.....	81

3.5.49.	I8123_GetSYNCID	82
3.5.50.	I8123_SendSYNCMsg	83
3.5.51.	I8123_GetCyclicSYNCInfo	84
3.5.52.	I8123_ChangeEMCYID.....	85
3.5.53.	I8123_SetEMCY_List	86
3.5.54.	I8123_GetEMCYID	87
3.5.55.	I8123_ReadLastEMCY	88
3.5.56.	I8123_GetBootUpNodeAfterAdd.....	89
3.5.57.	I8123_GetEMCYData.....	90
3.5.58.	I8123_GetNMTError	91
3.5.59.	I8123_InstallBootUpISR.....	92
3.5.60.	I8123_RemoveBootUpISR.....	93
3.5.61.	I8123_InstallEMCYISR	94
3.5.62.	I8123_RemoveEMCYISR	95
3.5.63.	I8123_InstallNMTErrISR.....	96
3.5.64.	I8123_RemoveNMTErrISR.....	97
3.5.65.	I8123_GetMasterReadSDOEvent	98
3.5.66.	I8123_GetMasterWriteSDOEvent.....	99
3.5.67.	I8123_ResponseMasterSDO.....	100
3.5.68.	I8123_InstallReadSDOISR	101
3.5.69.	I8123_RemoveReadSDOISR	102
3.5.70.	I8123_InstallWriteSDOISR	103
3.5.71.	I8123_RemoveWriteSDOISR	104
3.5.72.	I8123_GetMasterRemotePDOEvent	105
3.5.73.	I8123_GetMasterRxPDOEvent	106
3.5.74.	I8123_ResponseMasterPDO.....	107
3.5.75.	I8123_InstallRxPDOISR	108
3.5.76.	I8123_RemoveRxPDOISR.....	109
3.5.77.	I8123_InstallRemotePDOISR.....	110
3.5.78.	I8123_RemoveRemotePDOISR.....	111
3.5.79.	I8123_SyncGroupCycUpdata	112
3.5.80.	I8123_SyncGroupCycSend.....	113
3.5.81.	I8123_SyncGroupClear	114

3.5.82.	I8123_GetSYNCGroupStopState	115
3.5.83.	I8123_InstallSYNCGroupISR.....	116
3.5.84.	I8123_RemoveSYNCGroupISR.....	117
4.	Demo Programs.....	118
4.1.	Brief of the demo programs	118
4.1.1.	Listen_Mode.....	119
4.1.2.	NMT_Protocol.....	120
4.1.3.	PDO_Parameter	121
4.1.4.	PDO_Protocol	122
4.1.5.	Scan_Node	123
4.1.6.	SDO_PDO_ISR.....	124
4.1.7.	SDO_Read	125
4.1.8.	SDO_Write	126
4.1.9.	SYNC_Protocol	127
4.1.10.	PDO_MultiData	128
5.	Update Firmware.....	129

1. General Information

1.1. CANopen Introduction

The CAN (Controller Area Network) is a kind of serial communication protocols, which efficiently supports distributed real-time control with a very high level of security. It is an especially suited for networking intelligent devices as well as sensors and actuators within a system or sub-system. In CAN networks, there is no addressing of subscribers or stations in the conventional sense, but instead, prioritized messages are transmitted. CANopen is one kind of the network protocols based on the CAN bus and it is applied in a low level network that provides the connections between simple industrial devices (sensors, actuators) and higher-level devices (controllers), as shown in the Figure 1.1.

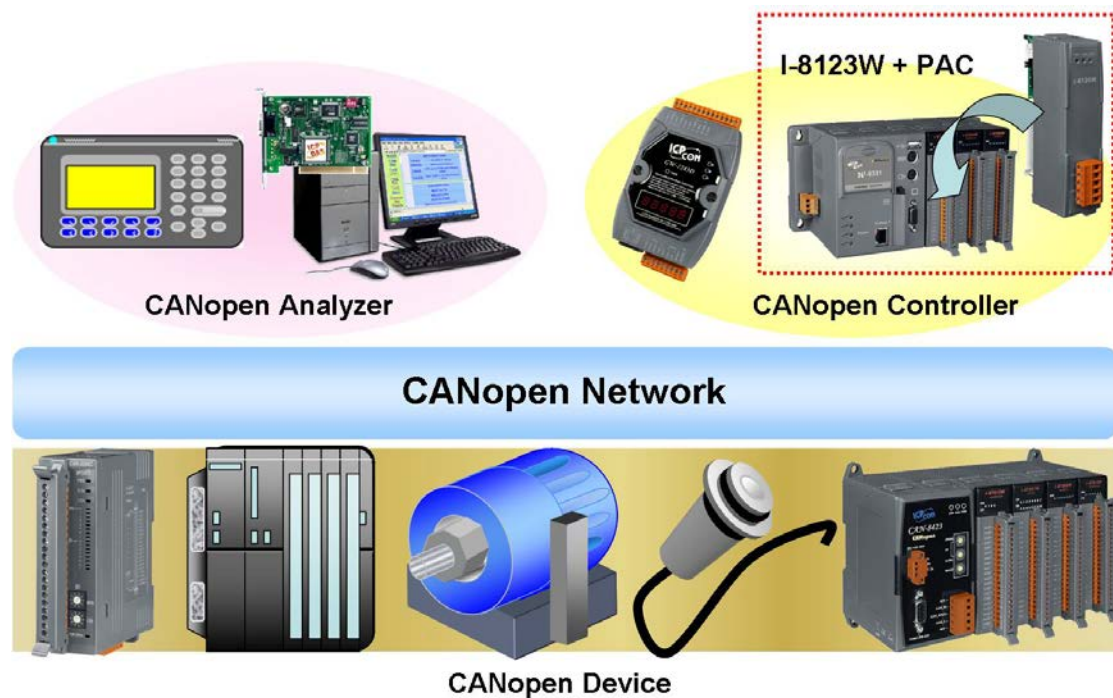


Figure 1.1 Example of the CANopen network

CANopen was developed as a standardized embedded network with highly flexible configuration capabilities. It provides standardized communication objects for real-time data (Process Data Objects, PDO), configuration data (Service Data Objects, SDO), network management data (NMT message, and Error Control), and special functions (Time Stamp, Sync message, and Emergency message). Nowadays, CANopen is

used for many various application fields, such as medical equipment, off-road vehicles, maritime electronics, public transportation, building automation and so on.

1.2. CANopen Applications

CANopen is the standardized network application layer optimized for embedded networks. Its specifications cover the standardized application layer, frameworks for the various applications (e.g. general I/O, motion control system, maritime electronics and so forth) as well as device, interface, and application profiles.

The main CANopen protocol and products are generally applied in the low-volume and mid-volume embedded systems. The following examples show some parts of the CANopen application fields. (For more information, please refer to the web site, <http://www.can-cia.org>):

- Truck-based superstructure control systems
- Off-highway and off-road vehicles
- Passenger and cargo trains
- Maritime electronics
- Factory automation
- Industrial machine control
- Lifts and escalators
- Building automation
- Medical equipment and devices
- Non-industrial control
- Non-industrial equipment



1.3. I-8123 Library Characteristics

In order to use the I-8123W and I-9123 module, we provide the I-8123W library for the Windows, WinCE and Linux PACs, and users can use it establish CANopen communication network rapidly. Most of the CANopen communication protocols, such as PDO, SDO and NMT, will be handled by the library automatically. Therefore, it is helpful to reduce the complexity of developing a CANopen master interface, and let users ignore the detail CANopen protocol technology. This library mainly supports connection sets of master-slave architecture, which include some useful functions to control the CANopen slave device in the CANopen network. The following figure describes the general application architecture of the I-8123W and I-9123.

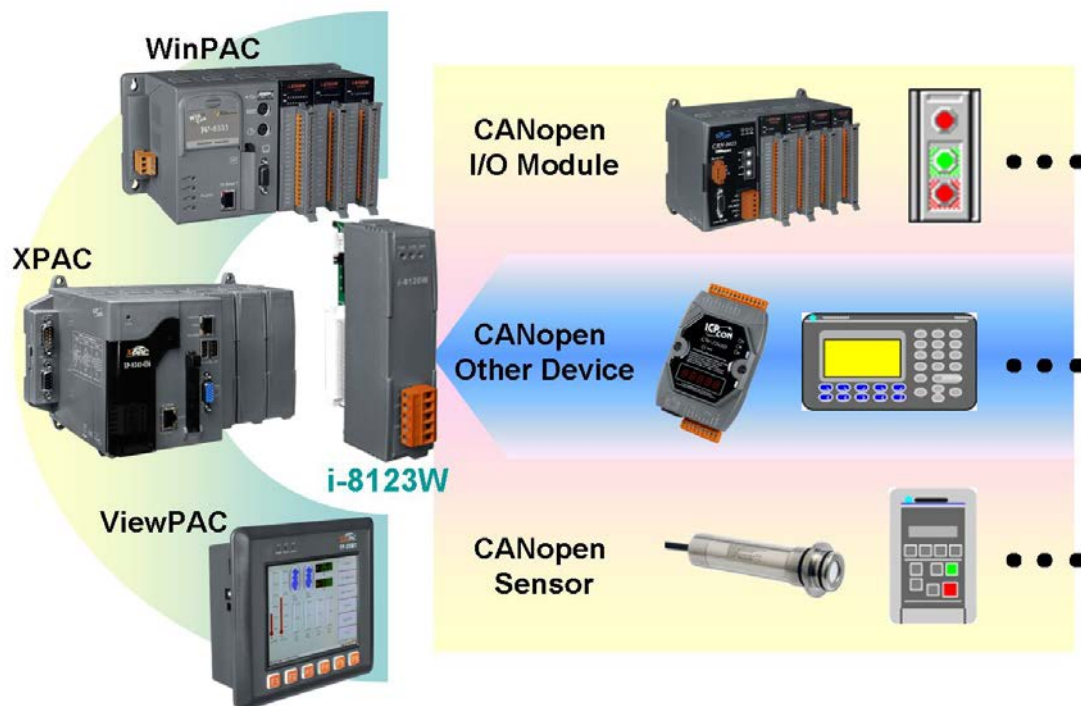


Figure 1.2 Application architecture

The I-8123W and I-9123 follows the CiA CANopen specification DS-301 V4.02, and supports the several CANopen features. The CANopen communication general concept is shown as Figure 1.3.

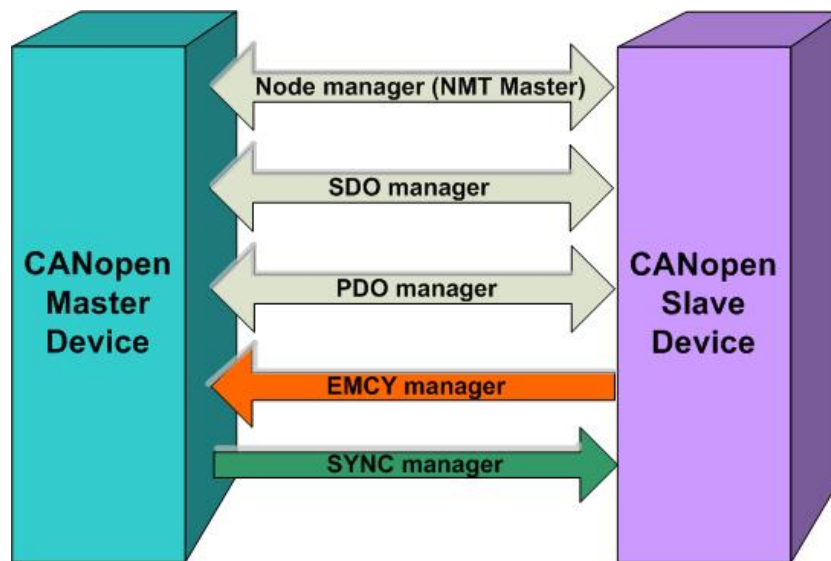


Figure 1.3 CANopen communication general concept

- **Node Manager (NMT Master)**
 - Functions for changing the slave device state
 - Node Guarding and Heartbeat Protocol for error control
 - Support Emergency (EMCY) messages
- **SDO Manager**
 - Expedited, segmented and block methods for SDO download and upload
- **PDO Manager**
 - Support all transmission types and event timer
- **SYNC Manager**
 - SYNC message production
 - SYNC cycles of 1ms resolution
- **EMCY Manager**
 - EMCY message consumer

For more information about the CANopen functions described above, please refer to the function descriptions and demo programs shown in the chapter 3 and chapter 4.

Specifications


- CPU:80186, 80 MHz
- NXP SJA1000 CAN controller with 16MHz clock
- NXP 82C250 CAN transceiver
- Power LED, Tx/Rx LED, Error LED
- Switch for 120Ω terminal resistor of CAN bus.
- CAN bus interface: ISO 11898-2, 5-pin screw terminal
- 2500 Vrms photo-coupled isolation on CAN side
- 1000 Vdc voltage protection
- Power Consumption: 2W
- Operating Temperature: -25°C to +75°C
- Storage Temperature: -30°C to +80°C
- Humidity: 10% ~ 90%, non-condensing

Features



- One CAN communication port.
- Support PAC with WinCE6, WinCE7, XPe, WES7, Win10 IoT.
- Library provides eVC++, VC++2005, C#.Net2005, and VB.Net2005 developments.
- Support InduSoft and ISaGRAF developments.
- Three indication LEDs (Pwr, Tx/Rx and Err LEDs).
- Support 8 kinds of baud rates: 10 kbps, 20 kbps, 50 kbps, 125 kbps, 250 kbps, 500 kbps, 800 kbps, and 1 Mbps.
- Support the node id range from 1 ~ 127.
- Follow CiA DS-301 V4.02.
- Support upload and download SDO Segment protocol.
- Support Node Guarding and Heartbeat protocol.
- Support EDS file.
- Provide Master Listen Mode to listen the CANopen slave status.
- Block-function and non-block-function selected.
- Demos and utility are provided.

2. Hardware Specification




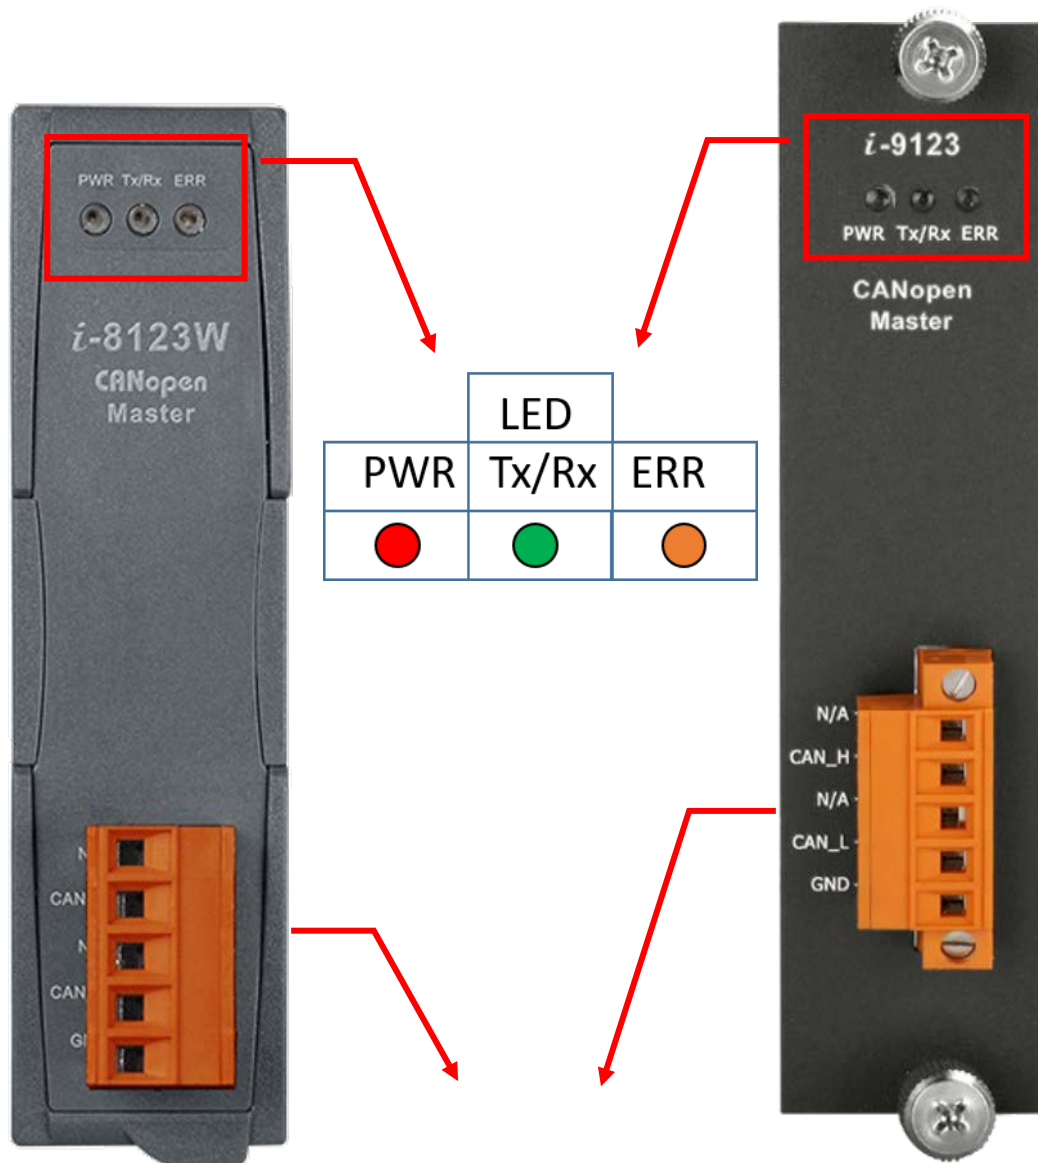

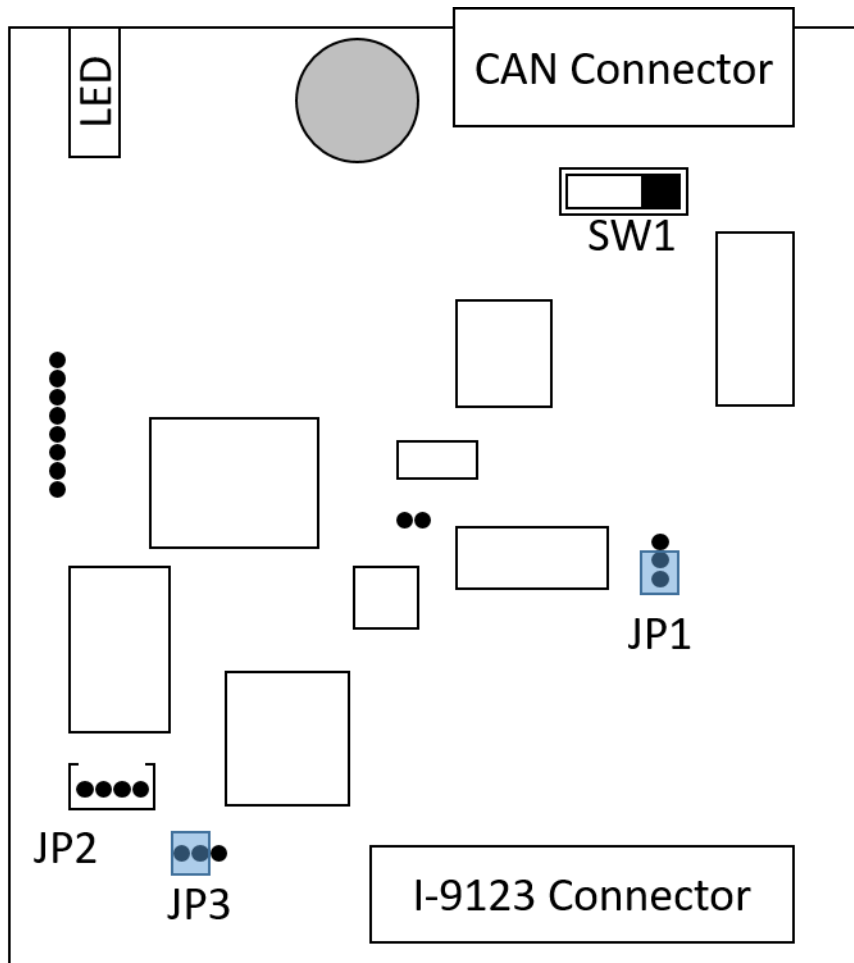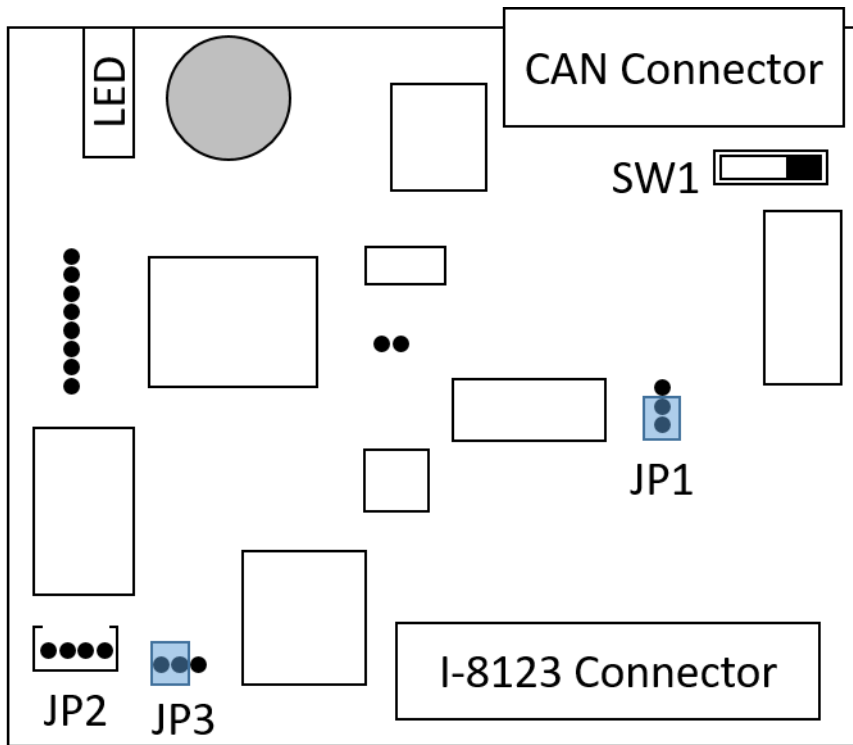

2.1. Hardware Structure



Pin No.	Signal	Description
1	CAN_GND	Ground / 0 V / V-
2	CAN_L	CAN_L bus line (dominant low)
3	F.G.	CAN Shield
4	CAN_H	CAN_H bus line (dominant high)
5	N/A	Non-available




The following table shows the definition of jumpers or switch. Users need to refer to this table to configure the I-8123W / I-9123 hardware.

Item	Name	Status	Description
SW1	Terminator Resistor	 Enable  Disable	CAN Port 120 Ω terminal resistance.
JP1	Flash Protect	 Flash Lock  Flash Unlock	Jumper for writing protection of flash memory. It can lock/unlock the flash memory to enable/disable the firmware download procedure. In harsh environment, it is useful to prevent flash memory access from noise or disturbances.
JP2	Debug Port	 CA-0904 RS-232 Cable	Sometimes engineers need to print some information through the Debug Port to help users solve problems.
JP3	Initial Pin	 Run  Initial	By default, the module is in Run mode. When switched to Initial mode, the module will not run the firmware during power-up, which is usually tested with Debug Port.

2.2. Wire Connection

In order to minimize the reflection effects on the CAN bus line, the CAN bus line has to be terminated at both ends by two terminator resistors as in the following figure. According to the ISO 11898-2 spec, each terminator resistor is 120Ω(or between 108Ω~132Ω). The length related resistance should have 70mΩ/m. Users should check the resistances of the CAN bus, before they install a new CAN network.

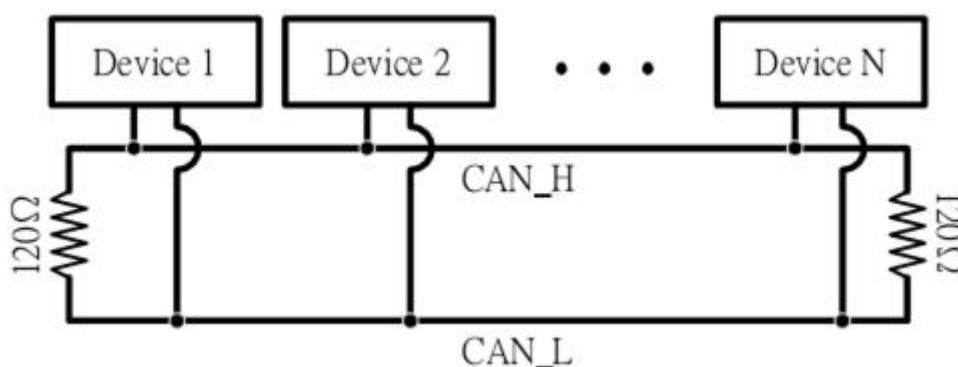

Moreover, to minimize the voltage drop over long distances, the terminator resistor should be higher than the value defined in the ISO 11898-2. The following table can be used as a good reference.

Bus Length (meter)	Bus Cable Parameters		Terminator Resistor (Ω)
	Length Related Resistance (mΩ/m)	Cross Section (Type)	
0~40	70	0.25(23AWG)~0.34mm ² (22AWG)	124 (0.1%)
40~300	<60	0.34(22AWG)~0.6mm ² (20AWG)	127 (0.1%)
300~600	<40	0.5~0.6mm ² (20AWG)	150~300
600~1K	<20	0.75~0.8mm ² (18AWG)	150~300

2.3. Power LED

The I-8123W/I-9123 needs 2W power consumption. If the electric power is supplied normally, the Power LED will be turn on always. If any other situation, please check the power supply or contact to your distributor.

2.4. Tx/Rx LED

Each I-8123W and I-9123 provide Tx/Rx LED to check the situations of the CAN messages transmission and reception. If the I-8123W/I-9123 is transmitting or receiving a CAN message, the Tx/Rx LED will blink. If the bus loading of the I-8123W/I-9123 is heavy, the Tx/Rx LED will be always turned on.

2.5. ERR LED

The ERR LED indicates the error status of the CAN physical layer and indicates the errors due to missing any CAN message.

3. I-8123 Function Library

3.1. Function List

In order to use the I-8123W/I-9123 more easily, we provide some useful and easy-to-use functions in the I-8123W library. There are several kinds of library versions for PACs. When using the library, the library version must be confirmed. The following table shows the all functions provided by the I-8123W library.

Listen Mode	Function Name	Description
O	I8123_GetVersion	Get the version of the I-8123W library
O	I8123_SetFunctionTimeout	Set the max. timeout value of all functions
O	I8123_GetCANStatus	Get CAN register status of the I-8123W/I-9123
O	I8123_InitMaster	Activate the I-8123W/I-9123 module
O	I8123_ShutdownMaster	Remove all nodes and stop the master
X	I8123_MasterSendBootupMsg	Let master send a NMT boot up message
O	I8123_SetMasterMode	Set the master to normal mode or listen mode
O	I8123_GetMasterMode	Get operation mode of the master
O	I8123_GetFirmwareVersion	Get the version of the I-8123W/I-9123 firmware
O	I8123_EDS_Load	Add a slave node from the EDS file
O	I8123_AddNode	Add a slave node into the master manager
O	I8123_RemoveNode	Remove a node from the master manager
X	I8123_RemoveAndResetNode	Remove the slave and then reset it from master
O	I8123_DelayAndResponseTimeout	Change minimum interval time and response timeout value of CAN messages
X	I8123_ScanNode	Scan all nodes on the CANopen network
O	I8123_GetNodeList	Get the node list of the master manager
X	I8123_NMTChangeState	Change the CANopen node state
O	I8123_NMTGetState	Get the CANopen node state
O	I8123_NMTGuarding	Start to the node guarding function
O	I8123_NMTHeartbeat	Start to the node heartbeat function
X	I8123_SDOReadData	Read data by using the upload SDO protocol
X	I8123_SDOReadFile	Read the huge SDO data for specific slave node
X	I8123_SDOWriteData	Write data by using the download SDO protocol
X	I8123_SDOAbortTransmit	Send the SDO abort message
X	I8123_PDOWrite	Use the PDO to write data to the CANopen node

X	I8123_PDOWrite_Fast	Only send out the RxPDO but not do any check
X	I8123_PDORemote	Use the PDO to get data from the CANopen node
X	I8123_PDORemote_Fast	Only send the Rtr message but don't check response
X	I8213_SetPDORemotePolling	Set PDO polling list table and poll them
O	I8123_GetPDOLastData	Get the last input or output PDO data
O	I8123_GetPDOLastData_Fast	Get the last PDO data from DPRAM directly
O	I8123_GetMultiPDOData	Get the several input or output PDO data once
O	I8123_GetMultiPDOData_Fast	Get the several PDO data from DPRAM directly
O	I8123_GetRxPDOID	Get all COB-ID of the RxPDO of the specific slave
O	I8123_GetTxPDOID	Get all COB-ID of the TxPDO of the specific slave
X	I8123_InstallPDO	Install and enable a specific PDO
X	I8123_DynamicPDO	New or change a PDO mapping to the slave
X	I8123_RemovePDO	Remove a specific PDO mapping entry or object
X	I8123_ChangePDOID	Change the PDO COB-ID of a specific slave
O	I8123_GetPDOMapInfo	Obtain all the PDO-related information
O	I8123_InstallPDO_List	Install a PDO manually without check if it exists
O	I8123_RemovePDO_List	Remove PDO object without check real states
X	I8123_PDOWUseEntry	Change the valid entry number of the PDO objects
X	I8123_PDOWTxType	Set transmission type of the specific TxPDO
X	I8123_PDOWEventTimer	Set event timer of the specific TxPDO
X	I8123_PDOWInhibitTime	Set inhibit time of the specific TxPDO
X	I8123_ChangeSYNCOID	Change the SYNC COB-ID
O	I8123_SetSYNC_List	Set the SYNC COB-ID without check if it exists
O	I8123_GetSYNCOID	Get the SYNC COB-ID
X	I8123_SendSYNCCMsg	Send the SYNC message
X	I8123_GetCyclicSYNCCInfo	Get all the cyclic sending SYNC information
X	I8123_ChangeEMCYID	Change the EMCY COB-ID
O	I8123_SetEMCY_List	Set the EMCY COB-ID and don't check if it exists
O	I8123_GetEMCYID	Get the EMCY COB-ID
O	I8123_ReadLastEMCY	Get the last EMCY message of the slave
O	I8123_GetBootUpNodeAfterAdd	Get boot up message of a slave that had been added
O	I8123_GetEMCYData	Get the EMCY message from the EMCY buffer
O	I8123_GetNMTError	Get the NMT Error event from the NMT event buffer
O	I8123_InstallBootUpISR	Install user-defined slave boot up process
O	I8123_RemoveBootUpISR	Remove the slave boot up process
O	I8123_InstallEMCYISR	Install user-defined EMCY process

O	I8123_RemoveEMCYISR	Remove the EMCY process
O	I8123_InstallNMTErrISR	Install user-defined Guarding/Heartbeat event process
O	I8123_RemoveNMTErrISR	Remove the Guarding/Heartbeat event process
O	I8123_GetMasterReadSDOEvent	Get the read SDO message sent to the master
O	I8123_GetMasterWriteSDOEvent	Get the write SDO message sent to the master
X	I8123_ResponseMasterSDO	Response the SDO message to the SDO sender
O	I8123_GetMasterRemotePDOEvent	Get the remote PDO message send to the master
O	I8123_GetMasterRxPDOEvent	Get the RxPDO RTR sent to the master
X	I8123_ResponseMasterPDO	Response the RxPDO RTR to the RTR sender
O	I8123_InstallReadSDOISR	Install the user-defined read master SDO process
O	I8123_RemoveReadSDOISR	Remove the read master SDO process
O	I8123_InstallWriteSDOISR	Install the user-defined write master SDO process
O	I8123_RemoveWriteSDOISR	Remove the write master SDO process
O	I8123_InstallRxPDOISR	Install the user-defined write master PDO process
O	I8123_RemoveRxPDOISR	Remove the write master PDO process
O	I8123_InstallTxPDOISR	Install the user-defined remote master PDO process
O	I8123_RemoveTxPDOISR	Remove the remote master PDO process
X	CPM100_SyncGroupCycUpdata	Update PDO group data for SYNC protocol
X	CPM100_SyncGroupCycSend	Start to send SYNC signal and followed PDO data
X	CPM100_SyncGroupClear	Clear SYNC and PDO group data in update buffer
X	CPM100_GetSYNCGroupStopState	Get the state of SYNC and PDO group send
X	CPM100_InstallSYNCGroupISR	Install the SYNC and PDO group data process
X	CPM100_RemoveSYNCGroupISR	Remove the SYNC and PDO group data process

Table 3.1 Description of functions

3.2. Function Return Code

The following table interprets all the return code returned by the master.

Return Code	Error ID	Description
0	CPM_NoError	OK
3	CPM_SlotNumberErr	There is no I-8123W/I-9123 on the specific slot No.
5	CPM_ConfigErr	The master hasn't been configured successfully
6	CPM_MasterInitErr	The master initialization error.
7	CPM_MasterNotInit	The master hasn't been initialized
8	CPM_ListenMode	The I-8123W/I-9123 is in listen mode now
9	CPM_NodeErr	Set node number error
10	CPM_NodeExist	The node had been added to the Master
12	CPM_TxBusy	Tx buffer is busy, please wait a minute to send again
13	CPM_UnknowCmd	This version of firmware doesn't support the function
14	CPM_CmdReceErr	I-8123W/I-9123 receive command of wrong length
15	CPM_DataEmpty	There is no data to receive
16	CPM_MemAllocErr	I-8123W/I-9123 has not enough memory
17	CPM_SendCycMsgErr	Cyclic message send error
18	CPM_StatusErr	NMT state of CANopen slave is error
20	CPM_SetGuardErr	Set Guarding and LifeTime parameter error
21	CPM_SetHbeatErr	Set Heartbeat parameter error
22	CPM_SegLenErr	SDO Segment receive error length
23	CPM_SegToggleErr	SDO Segment receive error toggle
24	CPM_SegWriteErr	SDO write segment error
25	CPM_Abort	The return message is an Abort message
26	CPM_PDOLenErr	PDO output data error
27	CPM_COBIDErr	The COB-ID isn't exist or isn't correct one
28	CPM_PDOLnstErr	Install the PDO object error
29	CPM_PDODynaErr	The PDO mapping data is setting error
30	CPM_PDONumErr	The PDO number and COB-ID is not match
31	CPM_PDOSetErr	PDO parameter is setting error
32	CPM_PDOLnstErr	The PDO entry parameter is more then useful entry
33	CPM_SetCobIdErr	The EMCY or SYNC COB-ID is setting error
34	CPM_CycFullErr	There are already 5 cyclic message running
35	CPM_Timeout	Message response timeout

36	CPM_DataLenErr	Data length setting error
37	CPM_SyncIdDifferent	SYNC ID is not the same for all slave group
40	CPM_Wait	Command is uncompleted (only for non-block mode)
41	CPM_Processing	Command is running (only for non-block mode)
50	CPM_LoadEDSErr	Loading the EDS file fails
51	CPM_EDSFormatErr	The format of the EDS file is incorrect

3.3. CANopen Master Library Application Flowchart

In this section, it describes that the operation procedure about how to use the CANopen Master Library to build users applications. This information is helpful for users to apply the CANopen Master Library easily. Besides, the CANopen operation principles must be obeyed when build a CANopen master application. For example, if the CANopen node is in the pre-operational status, the PDO communication object is not allowed to use. For more detail information, please refer to the demo programs in the section 4.

When users programs apply the CANopen Master Library functions, the function I8123_InitMaster must be called first. The function is used to initialize I-8123W/I-9123 and configure the CAN port.

After initializing the CAN interface successfully, users need to use the function I8123_AddNode or I8123_EDS_Load to install at least one CANopen device into the node list. The function I8123_AddNode can install slave node automatically or manually. When the user applies the function to install node manually, the PDO ID, SYNC ID, and EMCY ID of the node must be added manually by the functions I8123_InstallPDO_List, I8123_SetSYNC_List, and I8123_SetEMCY_List.

If the function I8123_InitMaster and I8123_AddNode / I8123_EDS_Load has been executed, the communication services (NMT, SYNC, EMCY, SDO, and PDO services) can be used at any time before calling the function I8123_ShutdownMaster, because the function I8123_ShutdownMaster will stop all process created by the function I8123_InitMaster.

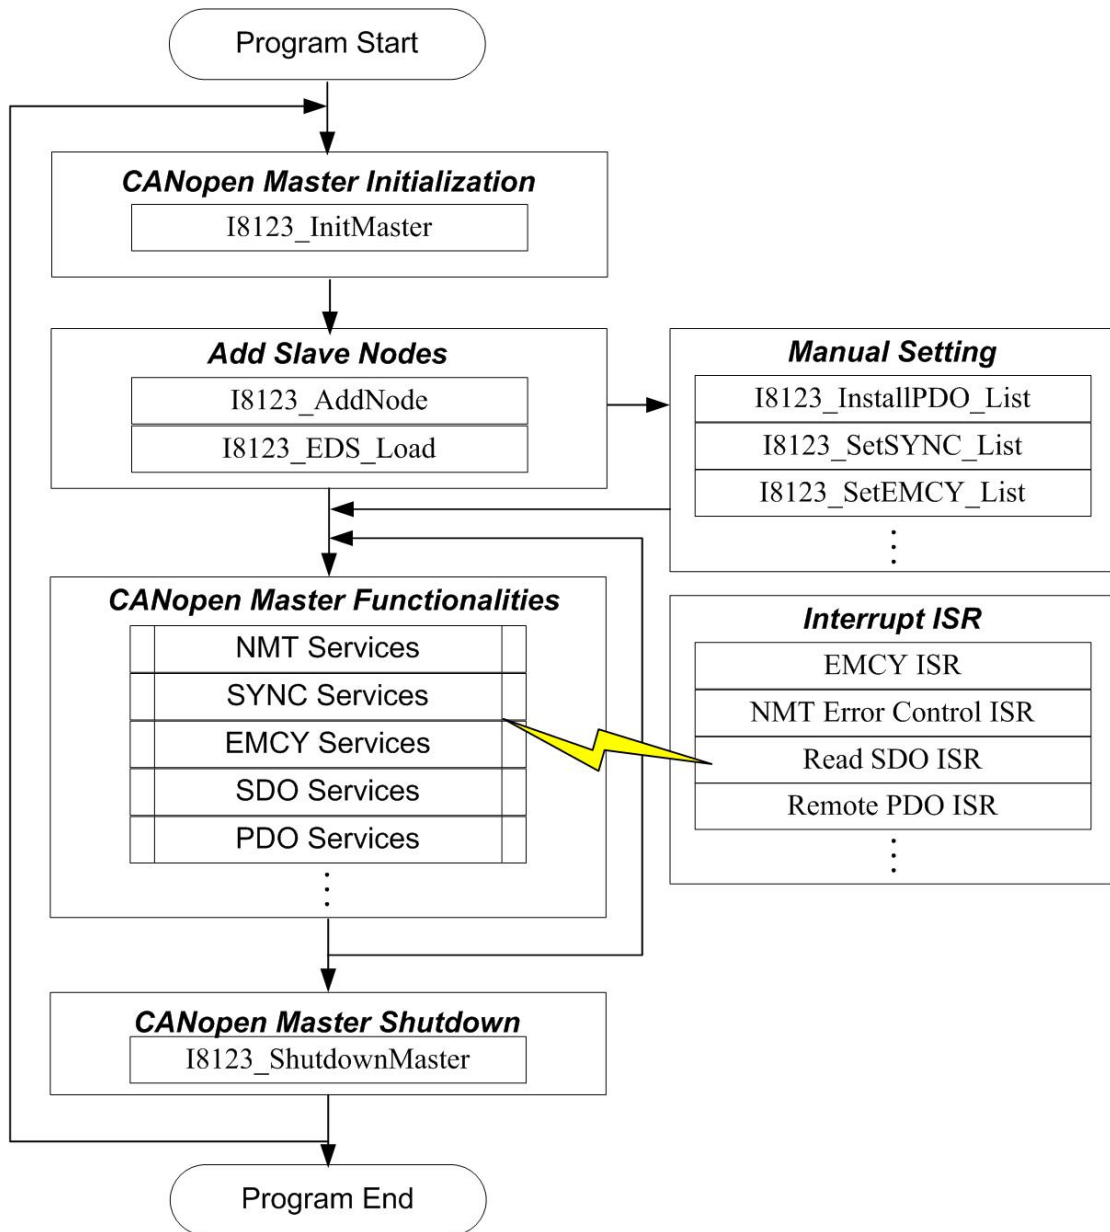


Figure 3.1 Main programming flow chart

3.4. Communication Services Introduction

NMT Services

The CANopen Master Library provides several NMT service functions, such as the functions I8123_AddNode, I8123_EDS_Load, I8123_RemoveNode, I8123_NMTChangeState, I8123_NMTGetState, I8123_NMTHeartbeat and I8123_NMTGuarding. As the prerequisite for the master, the slave nodes have to be registered by the function I8123_AddNode or I8123_EDS_Load with providing its Node-ID. The registered slave nodes can be individually removed from the node list by the function I8123_RemoveNode. Through NMT services, the NMT Master controls the state of the slaves. Table 3.3 is the command value and corresponding NMT command for the input parameters of the function I8123_NMTChangeState. When using the function I8123_NMTGetState, the slave status values and their descriptions are shown in the table 3.4. The Node Guarding and Heartbeat protocol are implemented via the function I8123_NMTGuarding and the function I8123_NMTHeartbeat. If the slave nodes are in the node list, users can change the node guarding or heartbeat parameters defined in the slave nodes by calling the function I8123_NMTGuarding or I8123_NMTHeartbeat.

Command Value	Description
1 (0x01)	Enter Operational
2 (0x02)	Stop
128 (0x80)	Enter Pre-Operational
129 (0x81)	Reset_Node
130 (0x82)	Reset_Communication

Table 3.3 NMT Command Specifier

State of Slave	Description
4 (0x04)	STOPPED
5 (0x05)	OPERATIONAL
127 (0x7F)	PRE-OPERATIONAL

Table 3.4 The state of the slaves

SDO Services

“Initiate SDO download protocol” or “Initiate SDO upload protocol” is used when the object data length ≤ 4 bytes. If the object data length > 4 bytes, “Download SDO segment protocol” or “Upload SDO segment protocol” will be used. Calling these two functions, I8123_SDOReadData and I8123_SDOWriteData, the initiate protocol and segment protocol will be selected automatically according to the object data length.

I8123_SDOAbortTransmit function can abort a pending SDO transfer at any time. Applying the abort service will have no confirmation from the slave device.

PDO Services

After using the I8123_AddNode to add a slave, the default TxPDOs and RxPDOs (TxPDO 1 ~ 10, RxPDO 1 ~ 10) will also be added to the I-8123W/I-9123's control list. If there are PDOs other than the default setting, the function I8123_InstallPDO is used for enabling these TxPDOs or RxPDOs object. After installing the PDOs, the function I8123_DynamicPDO can add or change the PDOs' mapping objects. Each PDO object supports 0~8 application objects. These application objects defined in the CANopen specification DS401, and they are mapped to the relative parameters of the DI/DO/AI/AO channels. After calling the function I8123_InstallPDO and I8123_DynamicPDO, the PDO communication object will be mapped and activated. If the PDO communication object is not needed no more, use the function I8123_RemovePDO to remove it.

When you want to output data via PDO, the function I8123_PDOWriteData is useful. This function can write all PDO 8-byte data or write some parts of PDO 8-byte data. Calling this function will send the specific data to the corresponding node via PDO protocol, and put the output data into PDO buffer at the same time. Therefore, you can check the output history of the PDO. But, if the connection between the

I-8123W/I-9123 and the slave is lost, the history output information may be not the same with the real status on the slave.

In CANopen specification, you can get the TxPDOs data by applying the remote transmit request CAN frame. The function I8123_PDORemote is needed in this case. Or you can use I8123_GetPDOLastData to get the last RxPDO and TxPDO data from the PDO buffer.

SYNC Services

Calling the function I8123_SendSYNCMsg starts the SYNC object transmission. This function supports single SYNC message transmission and cyclic SYNC message transmission. The parameter "Timer" of the function I8123_SendSYNCMsg can adjust the cyclic period of the SYNC COB-ID sent by master. And the parameter "Times" can set the sending times of the SYNC message. If the timer parameter is set to 0, the SYNC object transmission will be stopped. When the times parameter is set to non-zero value, the function will send the SYNC message until the timer is set to 0 or the parameter "Times" is achieved.

EMCY Services

The Emergency messages are triggered by the occurrence of a device internal error situation. Users can call the function I8123_ReadLastEMCY to receive the EMCY message or the function I8123_InstallEMCYISR to install user-defined EMCY interrupt process. In this case, if there are CAN slaves sending the EMCY, these EMCY messages will be processed by the user-defined EMCY interrupt process.

3.5.Function Description

3.5.1. I8123_GetVersion

- **Description:**

This function is used to obtain the version information of the I8123W.lib library.

- **Syntax:**

WORD I8123_GetVersion(**void**)

- **Parameter:**

None

- **Return:**

The library version information.

3.5.2. I8123_SetFunctionTimeout

- **Description:**

Sometimes, some function cost more time to complete its task, such as I8123_ScanNode. If some API of the I-8123W library never gets the feedback from the I-8123W/I-9123 until timeout value goes by, the error code "CPM_Timeout" will be returned. Through this function, the user can adjust the suitable maximum timeout value of all functions for application. Default timeout value is 1 second.

- **Syntax:**

`void I8123_SetFunctionTimeout(BYTE SlotNo, WORD Timeout)`

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

Timeout: [input] Maximum timeout value of all functions (ms).

3.5.3. I8123_GetCANStatus

- **Description:**

Obtain the status of the CAN controller of the specific I-8123W/I-9123 board

- **Syntax:**

WORD I8123_GetCANStatus (**BYTE** SlotNo, **BYTE** *Status)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

***Status:** [output] The pointer for obtaining the CAN status. It indicates the value of status register of SJA1000. Its meanings are described below.

Bit NO.	Description
7 (MSB)	Bus status. 1 for bus off, 0 for bus on.
6	Error status. 1 for at least one error, 0 for OK.
5	SJA1000 Transmit status. 1 for transmitting, 0 for idle
4	SJA1000Receive status. 1 for receiving, 0 for idles.
3	SJA1000 Transmit completes status. 1 for complete, 0 for incomplete.
2	SJA1000 Transmit buffer status. 1 for released, 0 for locked.
1	Data overrun status. 1 for SJA1000 reception buffer overrun, 0 for OK.
0 (LSB)	Receive buffer status. 1 for at least one message stored in the SJA1000 reception buffer, 0 for empty.

3.5.4. I8123_InitMaster

- **Description:**

The function must be applied when configuring the CAN controller and initialize the I-8123W/I-9123. It must be called once before using other functions of the I8123W.lib.

- **Syntax:**

WORD I8123_InitMaster(**BYTE** SlotNo, **BYTE** Node, **BYTE** BaudRate, **BYTE** BlockMode)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

Node: [input] Master's node ID. If the parameter is 0, the master will be a normal master, and no other master can control it. If the parameter is 1 ~ 127 (different from other slave), other master can do some control to it through some ISR function.

BaudRate: [input] The baudrate of the I-8123W/I-9123

Value	Baud rate	Value	Baud rate
0	10Kbps	4	250Kbps
1	20Kbps	5	500Kbps
2	50Kbps	6	800Kbps
3	125Kbps	7	1Mbps

BlockMode: [input] 0 means this function is non-block-function, and 1 means this function is block-function. If set this parameter to 1, the running procedure of the users' application will be held in the function until return. If set to 0, this function will return "CPM_Processing" directly. This function will return its process status while users apply it with the same "SlotNo" and "Node" again. If the procedure is still not complete, it will return "CPM_Wait" .

3.5.5. I8123_ShutdownMaster

- **Description:**

The function I8123_ShutdownMaster removes all the slaves that had added to master and stop all the functions of the I-8123W/I-9123. The function must be called before exit the users' application programs.

- **Syntax:**

WORD I8123_ShutdownMaster (**BYTE** SlotNo)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

3.5.6. I8123_MasterSendBootupMsg

- **Description:**

To use the function I8123_MasterSendBootupMsg can let I-8123W /I-9123 sends a boot up message after I8123_InitMaster is called.

Note: The function is valid while the Node parameter of the function I8123_InitMaster is > 0.

- **Syntax:**

WORD I8123_MasterSendBootupMsg(**BYTE** SlotNo,
BYTE BlockMode)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

BlockMode: [input] 0 means this function is non-block-function, and 1 means this function is block-function. If set this parameter to 1, the running procedure of the users' application will be held in the function until return. If set to 0, this function will return "CPM_Processing" directly. This function will return its process status while users apply it with the same "SlotNo" again. If the procedure is still not complete, it will return "CPM_Wait" .

3.5.7. I8123_SetMasterMode

- **Description:**

This function can configure if the master is into listen mode or normal mode (default mode). In listen mode, the I-8123W/I-9123 can't send any CANopen message, and some functions will be useless in this mode. User can select normal mode or listen mode at any time after calling function I8123_InitMaster.

- **Syntax:**

WORD I8123_SetMasterMode(**BYTE** SlotNo, **BYTE** Mode,
BYTE BlockMode)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

Mode: [input] 1 is listen mode, and others are normal mode (default mode).

BlockMode: [input] 0 means this function is non-block-function, and 1 means this function is block-function. If set this parameter to 1, the running procedure of the users' application will be held in the function until return. If set to 0, this function will return "CPM_Processing" directly. This function will return its process status while users apply it with the same "SlotNo" again. If the procedure is still not complete, it will return "CPM_Wait" .

3.5.8. I8123_GetMasterMode

- **Description:**

If user want to know what operation mode of the master is, call the function to get it.

- **Syntax:**

WORD I8123_GetMasterMode(**BYTE** SlotNo, **BYTE** *Mode,
BYTE BlockMode)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

***Mode:** [output] 0 is normal mode (default mode), and 1 is listen mode.

BlockMode: [input] 0 means this function is non-block-function, and 1 means this function is block-function. If set this parameter to 1, the running procedure of the users' application will be held in the function until return. If set to 0, this function will return "CPM_Processing" directly. This function will return its process status while users apply it with the same "SlotNo" again. If the procedure is still not complete, it will return "CPM_Wait" .

3.5.9. I8123_GetFirmwareVersion

- **Description:**

The function allows users to determine the firmware version number of the I-8123W/I-9123.

- **Syntax:**

WORD I8123_GetFirmwareVersion (**BYTE** SlotNo, **WORD** *Fir_Ver, **BYTE** BlockMode)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

***Fir_Ver:** [output] I-8123W/I-9123 firmware version information.

BlockMode: [input] 0 means this function is non-block-function, and 1 means this function is block-function. If set this parameter to 1, the running procedure of the users' application will be held in the function until return. If set to 0, this function will return "CPM_Processing" directly. This function will return its process status while users apply it with the same "SlotNo" again. If the procedure is still not complete, it will return "CPM_Wait" .

3.5.10. I8123_EDS_Load

- **Description:**

The function I8123_EDS_Load can let users load EDS file for adding a CANopen slave with specified Node ID into the master node list. Using this function will not send any message to check if the slave is existent or not.

- **Syntax:**

WORD I8123_EDS_Load (**BYTE** SlotNo, **BYTE** Node, **char** *FilePath, **WORD** DelayTime, **WORD** ResTimeout, **BYTE** BlockMode)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

Node: [input] Slave device Node-ID (1~127).

***FilePath:** [input] Absolute or relative file path of the EDS file.

DelayTime: [input] The parameter defines the time interval between sending two messages from the I-8123W/I-9123. It can avoid the master frequently sending messages that may overrun the buffer of the slave. Too large value of this parameter reduces the performance of the master. The unit of the parameter is ms. This parameter will be applied to the specified slave after finishing the ESD loading.

ResTimeout: [input] The timeout value of the response of the CANopen slaves. When the master sends a CANopen message to the slave, it will wait the response until timeout if there is a response. The unit of this parameter is millisecond. This parameter will be applied to the specified slave after finishing the ESD loading.

BlockMode: [input] 0 means this function is non-block-function, and 1 is block-function. If set this parameter to 1, the running procedure of the users' application is held until finishing this function. If 0, this function returns "CPM_Processing" directly. While users apply it with the same "SlotNo" again, it returns the process status. If the procedure is still not complete, it returns "CPM_Wait" .

3.5.11. I8123_AddNode

- **Description:**

The function I8123_AddNode can add a CANopen slave with specified Node ID into the master node list. There are three mode of the function. Mode 1 is adding node automatically, mode 2 is adding node manually, and mode 3 is waiting node's boot up message for add. In the automatic mode, after calling this function to add a slave, the slave will be into the operational state directly. And master will scan the TxPDO1 ~ TxPDO10 and RxPDO1 ~ RxPDO10 and install them into the firmware of the I-8123W/I-9123 if the slave supports these PDO objects. In the manual mode, this function will add a CANopen slave into the master node list only, and will not send any message to check if the slave is existent or not. Besides, the manual mode doesn't install the SYNC ID, EMCY ID, and any PDO object into the firmware of the I-8123W/I-9123. Users must call I8123_SetSYNC_List, I8123_SetEMCY_List, and I8123_InstallPDO_List to complete the object installation to finish the adding node process.

The added node can be removed from the master node list by the function I8123_RemoveNode.

- **Syntax:**

WORD I8123_AddNode(**BYTE** SlotNo, **BYTE** Node, **BYTE** AddMode, **WORD** DelayTime, **WORD** ResTimeout, **BYTE** BlockMode)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

Node: [input] Slave device Node-ID (1~127).

AddMode: [input] 1: Automatic mode. 2: Manual mode.

DelayTime: [input] The parameter is the shortest time interval

between sending two messages from the I-8123W/I-9123. It can avoid the master to send too much CANopen messages in a short time that may let some slaves occur the errors. But if the delay time is too long, the performance of the master is down. The unit of the parameter is ms.

ResTimeout: [input] The timeout value of the responded messages from the CANopen slaves. When the master sends a CANopen message to the slave, it will wait the feedback until timeout if there is a feedback. The unit of this parameter is millisecond.

BlockMode: [input] 0 means this function is non-block-function, and 1 means this function is block-function. If set this parameter to 1, the running procedure of the users' application will be held in the function until return. If set to 0, this function will return "CPM_Processing" directly. This function will return its process status while users apply it with the same "SlotNo" and "Node" again. If the procedure is still not complete, it will return "CPM_Wait" .

3.5.12. I8123_RemoveNode

- **Description:**

The function I8123_RemoveNode removes the slave with the specified Node-ID from node list of the master. It requires a valid Node-ID, which has installed by the function I8123_AddNode before.

- **Syntax:**

WORD I8123_RemoveNode(**BYTE** SlotNo, **BYTE** Node,
BYTE BlockMode)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

Node: [input] Slave device Node-ID (1~127).

BlockMode: [input] 0 means this function is non-block-function, and 1 means this function is block-function. If set this parameter to 1, the running procedure of the users' application will be held in the function until return. If set to 0, this function will return "CPM_Processing" directly. This function will return its process status while users apply it with the same "SlotNo" and "Node" again. If the procedure is still not complete, it will return "CPM_Wait" .

3.5.13. I8123_RemoveAndResetNode

- **Description:**

The function I8123_RemoveAndResetNode removes the slave with the specified Node-ID from node list of the master and reset the slave. It requires a valid Node-ID, which has installed by the function I8123_AddNode before.

- **Syntax:**

WORD I8123_RemoveAndResetNode(**BYTE** SlotNo, **BYTE** Node,
BYTE BlockMode)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

Node: [input] Slave device Node-ID (1~127).

BlockMode: [input] 0 means this function is non-block-function, and 1 means this function is block-function. If set this parameter to 1, the running procedure of the users' application will be held in the function until return. If set to 0, this function will return "CPM_Processing" directly. This function will return its process status while users apply it with the same "SlotNo" and "Node" again. If the procedure is still not complete, it will return "CPM_Wait" .

3.5.14. I8123_DelayAndResponseTimeout

- **Description:**

Call the function to change CAN message minimum interval time and response timeout value of the slave node at any time.

- **Syntax:**

WORD I8123_DelayAndResponseTimeout(**BYTE** SlotNo, **BYTE** Node, **WORD** DelayTime, **WORD** ResTimeout, **BYTE** BlockMode)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

Node: [input] Slave device Node-ID (1~127).

DelayTime: [input] The parameter is the same as "DelayTime" of the function I8123_AddNode.

ResTimeout: [input] The parameter is the same as "ResTimeout" of the function I8123_AddNode.

BlockMode: [input] 0 means this function is non-block-function, and 1 means this function is block-function. If set this parameter to 1, the running procedure of the users' application will be held in the function until return. If set to 0, this function will return "CPM_Processing" directly. This function will return its process status while users apply it with the same "SlotNo" and "Node" again. If the procedure is still not complete, it will return "CPM_Wait" .

3.5.15. I8123_ScanNode

- **Description:**

User can use the function I8123_ScanNode to know how many slave nodes are on the CANopen network.

- **Syntax:**

WORD I8123_ScanNode(**BYTE** SlotNo, **BYTE** S_Node, **BYTE** E_Node, **BYTE** *NodeList, **BYTE** BlockMode)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

S_Node: [input] Start node ID.

E_Node: [input] End node ID. This function will scan node ID from S_Node to E_Node. If S_Node >= E_Node, it will scan all slave node ID (1 ~ 127) on the CANopen network.

***NodeList:** [output] This is a 16-byte array parameter. Each bit of the parameter means a node ID, the bit is 0 means that the node ID doesn't exist and 1 means the node ID is on the CANopen network. For example, if the NodeList[0] is 0x16 (0001 0110), it means that the nodes with ID 1, 2, and 4 exist, and the nodes with ID 0, 3, 5, 6, and 7 don't exist. If the NodeList[1] is 0x41 (0100 0001), it means that the nodes with ID 8 and 14 exist, and the nodes with ID 9, 10, 11, 12, 13, and 15 don't exist.

BlockMode: [input] 0 means this function is non-block-function, and 1 means this function is block-function. If set this parameter to 1, the running procedure of the users' application will be held in the function until return. If set to 0, this function will return "CPM_Processing" directly. This

function will return its process status while users apply it with the same "SlotNo" again. If the procedure is still not complete, it will return "CPM_Wait" .

3.5.16. I8123_GetNodeList

- **Description:**

User can use the function I8123_GetNodeList to know how many slave nodes are added to the node list of the I-8123W/I-9123.

- **Syntax:**

WORD I8123_GetNodeList(**BYTE** SlotNo, **BYTE** *NodeList,
BYTE BlockMode)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

***NodeList:** [output] This is a 16-byte array parameter. Each bit of the parameter means a node ID, the bit is 0 means the node ID not exist and 1 means the node ID now on the CANopen bus. For example, if the NodeList[0] is 0x16 (0001 0110), it means that the nodes with ID 1, 2, and 4 have been added into node list, and the nodes with ID 0, 3, 5, 6, and 7 don't. If the NodeList[1] is 0x41 (0100 0001), it means that the nodes with ID 8 and 14 have been added into node list, and the nodes with ID 9, 10, 11, 12, 13, and 15 don't.

BlockMode: [input] 0 means this function is non-block-function, and 1 means this function is block-function. If set this parameter to 1, the running procedure of the users' application will be held in the function until return. If set to 0, this function will return "CPM_Processing" directly. This function will return its process status while users apply it with the same "SlotNo" again. If the procedure is still not complete, it will return "CPM_Wait" .

3.5.17. I8123_NMTChangeState

- **Description:**

The function I8123_NMTChangeState is used to change the NMT state of a slave. If the node parameter of this function is set to 0, the state of all nodes on the same CANopen network will be changed.

- **Syntax:**

WORD I8123_NMTChangeState(BYTE SlotNo, BYTE Node,
BYTE State, BYTE BlockMode)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

Node: [input] Slave device Node-ID (1~127). Set this parameter to 0 to indicate all slave devices.

State: [input] NMT command specifier.

1: start

2: stop

128: enter PRE-OPERATIONAL

129: Reset_Node

130: Reset_Communication

BlockMode: [input] 0 means this function is non-block-function, and 1 means this function is block-function. If set this parameter to 1, the running procedure of the users' application will be held in the function until return. If set to 0, this function will return "CPM_Processing" directly. This function will return its process status while users apply it with the same "SlotNo" and "Node" again. If the procedure is still not complete, it will return "CPM_Wait" .

3.5.18. I8123_NMTGetState

- **Description:**

The function I8123_NMTGetState can get the NMT state from slaves.

- **Syntax:**

WORD I8123_NMTGetState(**BYTE** SlotNo, **BYTE** Node, **BYTE** *State, **BYTE** BlockMode)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

Node: [input] Slave device Node-ID (1~127).

***State:** [output] The NMT state of the slave.

4: STOPPED

5: OPERATIONAL

127: PRE-OPERATIONAL

BlockMode: [input] 0 means this function is non-block-function, and 1 means this function is block-function. If set this parameter to 1, the running procedure of the users' application will be held in the function until return. If set to 0, this function will return "CPM_Processing" directly. This function will return its process status while users apply it with the same "SlotNo" and "Node" again. If the procedure is still not complete, it will return "CPM_Wait" .

3.5.19. I8123_NMTGuarding

- **Description:**

Use the function I8123_NMTGuarding to set guard time and life time factor of the slave with the specified node ID. Then, the master will automatically send the guarding message to slave device according to the "GuardTime" parameters of this function. If the master doesn't receive the confirmation of guarding message from the slave, the I-8123W/I-9123 will produce a Node_Guarding_Event event to users. Users may use the function I8123_InstallNMTErrISR to install a user-defined process to get the guarding fail event and process the guarding fail procedure. However, if the slave doesn't receive the guarding message during the Node Life time period (Node Life time = "GuardTime" * "LifeTime"), it will be triggered to send the EMCY message. It is recommended that "LifeTime" value is set to more than 1.

Take a note that following the CANopen specification, it is not allowed for one slave device to use both error control mechanisms Guarding Protocol and Heartbeat Protocol at the same time.

- **Syntax:**

WORD I8123_NMGuarding(**BYTE** SlotNo, **BYTE** Node,
WORD GuardTime, **BYTE** LifeTime, **BYTE** BlockMode)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

Node: [input] Slave device Node-ID (1~127).

GuardTime: [input] Guard Time (1 ~ 65535 ms).

LifeTime: [input] Life Time Factor (1 ~ 255).

BlockMode: [input] 0 means this function is non-block-function, and 1 means this function is block-function. If set this parameter to 1, the running procedure of the users'

application will be held in the function until return. If set to 0, this function will return "CPM_Processing" directly. This function will return its process status while users apply it with the same "SlotNo" and "Node" again. If the procedure is still not complete, it will return "CPM_Wait" .

3.5.20. I8123_NMTHearbeat

- **Description:**

Use the function I8123_NMTHearbeat to set heartbeat time of the slave with the specified node ID and consume time with the I-8123W/I-9123. Then, the slave will automatically send the heartbeat message to master according to the "ProduceTime" parameters of this function. If the master doesn't receive the heartbeat message from the slave until the "ConsumeTime" time (unit is millisecond) is up, the I-8123W/I-9123 will produce a "Heartbeat_Event" event to users. Users may use the function I8123_InstallNMTErrISR to install a user-defined process to get the heartbeat fail event and process the heartbeat fail procedure. It is recommended that "ConsumeTime" value is set to bigger than the "ProduceTime" value.

Take a note that following the CANopen specification, it is not allowed for one slave device to use both error control mechanisms Guarding Protocol and Heartbeat Protocol at the same time.

- **Syntax:**

WORD I8123_NMHartbeat(**BYTE** SlotNo, **BYTE** Node,
WORD ProduceTime, **WORD** ConsumeTime,
BYTE BlockMode)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

Node: [input] Slave device Node-ID (1~127).

ProduceTime: [input] Produce Time of slave device (1 ~ 65535 ms).

ConsumeTime: [input] Consume Time of master (1 ~ 65535 ms).

BlockMode: [input] 0 means this function is non-block-function, and 1 means this function is block-function. If set this parameter to 1, the running procedure of the users'

application will be held in the function until return. If set to 0, this function will return "CPM_Processing" directly. This function will return its process status while users apply it with the same "SlotNo" and "Node" again. If the procedure is still not complete, it will return "CPM_Wait" .

3.5.21. I8123_SDOReadData

- **Description:**

The function I8123_SDOReadData is useful to the SDO upload from a specified slave. When users use this function, pass the slave device node ID, object index and object subindex into this function. This function supports both expedition mode (less than 4-byte data length) and segment mode (more than 4-byte data length).

- **Syntax:**

WORD I8123_SDOReadData (**BYTE** SlotNo, **BYTE** Node,
WORD Index, **BYTE** SubIndex,
DWORD *RDLen, **BYTE** *RData,
BYTE BlockMode)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

Node: [input] Slave device Node-ID (1~127).

Index: [input] Object index of object dictionary of slave devices.

SubIndex: [input] Object subindex of object dictionary of slave devices.

***RDLen:** [output] Total data length.

***RData:** [output] SDO data respond from the specified slave device.

BlockMode: [input] 0 means this function is non-block-function, and 1 means this function is block-function. If set this parameter to 1, the running procedure of the users' application will be held in the function until return. If set to 0, this function will return "CPM_Processing" directly. This function will return its process status while users apply it with the same "SlotNo" and "Node" again. If the procedure is still not complete, it will return "CPM_Wait" .

3.5.22. I8123_SDORedFile

- **Description:**

The function I8123_SDORedFile is useful as uploading the SDO data more than 1024 bytes. While users use the I8123_ReadData to read the SDO data and the return data length is more than 1024 byte. The SDO data are stored in a file. Users can use the function I8123_SDORedFile for reading the SDO data from the file.

- **Syntax:**

WORD I8123_SDORedFile (**BYTE** SlotNo, **BYTE** Node,
WORD Index, **BYTE** SubIndex,
DWORD Start, **DWORD** Len,
DWORD *RLen, **BYTE** *RData)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

Node: [input] Slave device Node-ID (1~127).

Index: [input] Object index of object dictionary of slave devices.

SubIndex: [input] Object subindex of object dictionary of slave devices.

Start: [input] Start position for reading the SDO data from file. The range is from 0 to maximum length.

Len: [input] Data length for reading the SDO data.

***RDLen:** [output] Returned data length in reality.

***RData:** [output] The SDO data respond from the specified slave device.

3.5.23. I8123_SDOWriteData

- **Description:**

The function I8123_SDOWriteData can send out a SDO message to the specified salve device. This procedure is also called download SDO protocol. The parameter node of the function I8123_SDOWriteData is used to point which slave device will receive this SDO message. Because the data length of each object stored in object dictionary is different, users need to know the data length when writing the object of the object dictionary of the specified slave devices. This function supports both expedition mode (less than 4-byte data length) and segment mode (more than 4-byte data length)

- **Syntax:**

WORD I8123_SDOWriteData (**BYTE** SlotNo, **BYTE** Node, **WORD** Index, **BYTE** SubIndex, **DWORD** TDLen, **BYTE** *TData, **WORD** *RDLen, **BYTE** *RData, **BYTE** BlockMode)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

Node: [input] Slave device Node-ID (1~127).

Index: [input] The index value of object of the object dictionary.

SubIndex: [input] The subindex value of object of the object dictionary.

TDLen: [input] Total data size to be written.

***TData:** [input] The SDO data written to slave device.

***RLen:** [output] Total data size of responded data.

***RData:** [output] SDO data responded from the specified slave device.

BlockMode: [input] 0 means this function is non-block-function,

and 1 means this function is block-function. If set this parameter to 1, the running procedure of the users' application will be held in the function until return. If set to 0, this function will return "CPM_Processing" directly. This function will return its process status while users apply it with the same "SlotNo" and "Node" again. If the procedure is still not complete, it will return "CPM_Wait" .

3.5.24. I8123_SDOAbortTransmit

- **Description:**

Call the function I8123_SDOAbortTransmit to cancel the SDO transmission. The parameter node of this function is used to specify which SDO communication will be terminated between the master and the specified slave device.

- **Syntax:**

WORD I8123_SDOAbortTransmit(**BYTE** SlotNo, **BYTE** Node,
WORD Index, **BYTE** SubIndex, **DWORD** *AData,
BYTE BlockMode)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

Node: [input] Slave device Node-ID (1~127).

Index: [input] The object index value of the object dictionary.

SubIndex: [input] The object subindex value of the object dictionary.

***AData:** [input] Abort data to be send to slave.

BlockMode: [input] 0 means this function is non-block-function, and 1 means this function is block-function. If set this parameter to 1, the running procedure of the users' application will be held in the function until return. If set to 0, this function will return "CPM_Processing" directly. This function will return its process status while users apply it with the same "SlotNo" and "Node" again. If the procedure is still not complete, it will return "CPM_Wait" .

3.5.25. I8123_PDOWrite

- **Description:**

To send a PDO message to a specified slave device, use the I8123_PDOWrite function. Before calling this function, if using a non-default PDO, first use I8123_InstallPDO to install the PDO object into the I-8123W/I-9123. Then, ensure the target slave is in operational mode by using I8123_NMTChangeState if needed. The offset parameter sets the starting position for the PDO data, while *TData and DLen specify the data and its length. This function updates the PDO buffer of the I-8123W/I-9123 with the provided data from the given offset and sends it to the slave device via the PDO protocol.

- **Syntax:**

WORD I8123_PDOWrite (**BYTE** SlotNo, **WORD** Cobid, **BYTE** Offset, **BYTE** DLen, **BYTE** *TData, **BYTE** BlockMode)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

Cobid: [input] COB-ID used by the PDO object.

Offset: [input] The start byte position of PDO data (0 ~ 7).

DLen: [input] data size (dlen + offset \leq 8 (total length of the PDO)).

***TData:** [output] The data pointer point to the PDO data.

BlockMode: [input] 0 means this function is non-block-function, and 1 means this function is block-function. If set this parameter to 1, the running procedure of the users' application will be held in the function until return. If set to 0, this function will return "CPM_Processing" directly. This function will return its process status while users apply it with the same "SlotNo" and "Cobid" again. If the procedure is still not complete, it will return "CPM_Wait" .

3.5.26. I8123_PDOWrite_Fast

- **Description:**

The function is like I8123_PDOWrite but does not check whether the PDO message really sends to CAN bus or not. So I8123_PDOWrite_Fast is about twice as faster than I8123_PDOWrite at high speed baud rate (greater than or equal to 250 kbps).

- **Syntax:**

WORD I8123_PDOWrite_Fast (**BYTE** SlotNo, **WORD** Cobid, **BYTE** Offset, **BYTE** DLen, **BYTE** *TData)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

Cobid: [input] COB-ID used by the PDO object.

Offset: [input] The start byte position of PDO data (0 ~ 7).

DLen: [input] data size (dlen + offset \leq 8 (total length of the PDO)).

***TData:** [output] The data pointer point to the PDO data.

3.5.27. I8123_PDORemote

- **Description:**

Use the function I8123_PDORemote to send a RTR (remote-transmit-request) PDO message to the slave device.

- **Syntax:**

WORD I8123_PDORemote (**BYTE** SlotNo, **WORD** Cobid,
BYTE *DLen, **BYTE** *TData,
BYTE BlockMode)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

Cobid: [input] COB-ID used by the PDO object.

***DLen:** [output] The data length of the RTR PDO message.

***TData:** [output] The PDO message received from the slave device.

BlockMode: [input] 0 means this function is non-block-function, and 1 means this function is block-function. If set this parameter to 1, the running procedure of the users' application will be held in the function until return. If set to 0, this function will return "CPM_Processing" directly. This function will return its process status while users apply it with the same "SlotNo" and "Cobid" again. If the procedure is still not complete, it will return "CPM_Wait" .

3.5.28. I8123_PDORemote_Fast

- **Description:**

Use the function I8123_PDORemote_Fast only to send a RTR (remote-transmit-request) PDO message to the slave device but not wait for the response message.

- **Syntax:**

WORD I8123_PDORemote_Fast (**BYTE** SlotNo, **WORD** Cobid)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

Cobid: [input] COB-ID used by the PDO object.

3.5.29. I8123_SetPDORemotePolling

- **Description:**

If the CANopen slaves do not support the event timer function of the TxPDOs, using the function I8123_SetPDORemotePolling can config the most 125 TxPDO objects into the remote polling list. Then, the I-8123W will poll the configured TxPDOs and update the data into buffer automatically. Users can use I8123_GetMultiPDOData to get these TxPDOs data from the buffer faster and easily.

- **Syntax:**

WORD I8123_SetPDORemotePolling (**BYTE** SlotNo, **BYTE** PDOCnt, **WORD** *Cobid, **WORD** PollingTime, **BYTE** BlockMode)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

PODCnt: [input] The number of the *Cobid array.

***Cobid:** [input] COB-ID array used by the TxPDO objects.

PollingTime: [input] The minimum polling timer for the COB-ID array.

BlockMode: [input] 0 means this function is non-block-function, and 1 means this function is block-function. If set this parameter to 1, the running procedure of the users' application will be held in the function until return. If set to 0, this function will return "CPM_Processing" directly. This function will return its process status while users apply it with the same "SlotNo" and "Cobid" again. If the procedure is still not complete, it will return "CPM_Wait" .

3.5.30. I8123_GetPDOLastData

- **Description:**

Using the function I8123_GetPDOLastData can get the last data of the RxPDO and TxPDO from the PDO data buffer. The last PDO data is saved in PDO buffer, so it may not be the same with the real situation.

- **Syntax:**

WORD I8123_GetPDOLastData (**BYTE** SlotNo, **WORD** Cobid,
BYTE *IsNew, **BYTE** *DLen, **BYTE** *RData,
BYTE BlockMode)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

Cobid: [input] COB-ID used by the PDO object.

***IsNew:** [output] Check the data if had been read before. 0 is been read before, and 1 is new one.

***DLen:** [output] The data length of the PDO message.

***RData:** [output] The PDO message gets from the PDO buffer.

BlockMode: [input] 0 means this function is non-block-function, and 1 means this function is block-function. If set this parameter to 1, the running procedure of the users' application will be held in the function until return. If set to 0, this function will return "CPM_Processing" directly. This function will return its process status while users apply it with the same "SlotNo" and "Cobid" again. If the procedure is still not complete, it will return "CPM_Wait" .

3.5.31. I8123_GetPDOLastData_Fast

- **Description:**

The function is like I8123_GetPDOLastData but gets PDO data from DPRAM instead from firmware. So I8123_GetPDOLastData_Fast is about twice as fast than I8123_GetPDOLastData.

- **Syntax:**

WORD I8123_GetPDOLastData_Last (**BYTE** SlotNo, **WORD** Cobid, **BYTE** *DLen, **BYTE** *RData)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

Cobid: [input] COB-ID used by the PDO object.

***DLen:** [output] The data length of the PDO message.

***RData:** [output] The PDO message gets from the PDO buffer.

3.5.32. I8123_GetMultiPDOData

- **Description:**

This can get the last data of the RxPDO and TxPDO from the PDO data buffer such as the function I8123_GetPDOLastData. But the difference between these two functions is that user can use the function I8123_GetMultiPDOData to get maximum 50 PDO data at the same time.

- **Syntax:**

WORD I8123_GetMuliPDOData (**BYTE** SlotNo, **BYTE** PDOCnt,
WORD *Cobid, **BYTE** *IsNew,
BYTE *DLen, **BYTE** *RData,
BYTE BlockMode)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

PODCnt: [input] Total PDO number that want to get.

***Cobid:** [input] Maximum 50 COB-ID used by the PDO objects.

***IsNew:** [output] Check these PDO data if they have been read before. 0 is to be read before, and 1 is new one.

***DLen:** [output] Total data length obtained from the PDO buffer.

***RData:** [output] The PDO messages get from the PDO buffer.

BlockMode: [input] 0 means this function is non-block-function, and 1 means this function is block-function. If set this parameter to 1, the running procedure of the users' application will be held in the function until return. If set to 0, this function will return "CPM_Processing" directly. This function will return its process status while users apply it with the same "SlotNo" and "Cobid" again. If the procedure is still not complete, it will return "CPM_Wait" .

3.5.33. I8123_GetMultiPDOData_Fast

- **Description:**

The function is like I8123_GetMultiPDOData but gets PDO data from DPRAM instead from firmware. So I8123_GetMultiPDOData_Fast is about twice as fast than I8123_GetMultiPDOData.

- **Syntax:**

WORD I8123_GetMultiPDOData_Fast (**BYTE** SlotNo, **BYTE** PDOCnt,
WORD *Cobid, **BYTE** *IsNew,
BYTE *DLen, **BYTE** *RData)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

PDOPCnt: [input] Total PDO number that want to get.

***Cobid:** [input] Maximum 50 COB-ID used by the PDO objects.

***IsNew:** [output] Check these PDO data if they have been read before. 0 is to be read before, and 1 is new one.

***DLen:** [output] Total data length obtained from the PDO buffer.

***RData:** [output] The PDO messages get from the PDO buffer.

3.5.34. I8123_GetRxPDOID

- **Description:**

Use the function I8123_GetRxPDOID to get all the RxPDO COB-IDs of the specified slave, which have been installed to the master.

- **Syntax:**

WORD I8123_GetRxPDOID (**BYTE** SlotNo, **BYTE** Node,
BYTE *PDO_Cnt, **WORD** *ID_List,
BYTE BlockMode)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

Node: [input] Slave device Node-ID (1~127).

***PDO_Cnt:** [output] The number of installed RxPDO.

***ID_List:** [output] The RxPDO COB-ID list.

BlockMode: [input] 0 means this function is non-block-function, and 1 means this function is block-function. If set this parameter to 1, the running procedure of the users' application will be held in the function until return. If set to 0, this function will return "CPM_Processing" directly. This function will return its process status while users apply it with the same "SlotNo" and "Node" again. If the procedure is still not complete, it will return "CPM_Wait" .

3.5.35. I8123_GetTxPDOID

- **Description:**

Use the function I8123_GetTxPDOID to get all the TxPDO COB-IDs of the specified slave, which have been installed to the master.

- **Syntax:**

WORD I8123_GetTxPDOID (**BYTE** SlotNo, **BYTE** Node,
BYTE *PDO_Cnt, **WORD** *ID_List,
BYTE BlockMode)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

Node: [input] Slave device Node-ID (1~127).

***PDO_Cnt:** [output] The number of installed TxPDO.

***ID_List:** [output] The TxPDO COB-ID list.

BlockMode: [input] 0 means this function is non-block-function, and 1 means this function is block-function. If set this parameter to 1, the running procedure of the users' application will be held in the function until return. If set to 0, this function will return "CPM_Processing" directly. This function will return its process status while users apply it with the same "SlotNo" and "Node" again. If the procedure is still not complete, it will return "CPM_Wait" .

3.5.36. I8123_InstallPDO

- **Description:**

After calling the I8123_InstallPDO function, a PDO COB-ID will be installed in the PDO object list of the CANopen Master Library stack. If the slave device has defined the default PDO object in RxPDO1 ~ RxPDO10 and TxPDO1 ~ TxPDO10, in this case, these default PDO will be installed automatically while using the function I8123_AddNode with automatic mode. Otherwise, the TxPDOs or RxPDOs need to be installed manually by calling the function I8123_InstallPDO.

- **Syntax:**

WORD I8123_InstallPDO(**BYTE** SlotNo, **BYTE** Node, **WORD** Cobid,
BYTE RxTx, **WORD** PDO_No,
BYTE BlockMode)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

Node: [input] Slave device Node-ID (1~127).

Cobid: [input] COB-ID used by the PDO object.

RxTx: [input] PDO type (0: RxPDO, 1: TxPDO).

PDO_No: [input] PDO mapping object No (1 ~ 512).

BlockMode: [input] 0 means this function is non-block-function, and 1 means this function is block-function. If set this parameter to 1, the running procedure of the users' application will be held in the function until return. If set to 0, this function will return "CPM_Processing" directly. This function will return its process status while users apply it with the same "SlotNo" and "Node" again. If the procedure is still not complete, it will return "CPM_Wait" .

3.5.37. I8123_DynamicPDO

- **Description:**

This function can modify the mapping data of PDO object in the PDO object list of the CANopen Master Library stack. Take a note that before calling this function user must check if the PDO had been installed in the I-8123W/I-9123.

- **Syntax:**

WORD I8123_DynamicPDO (**BYTE** SlotNo, **BYTE** Node,
WORD Cobid, **BYTE** RxTx, **BYTE** Entry,
DWORD EntryData, **BYTE** BlockMode)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

Node: [input] Slave device Node-ID (1~127).

Cobid: [input] COB-ID used by the PDO object.

RxTx: [input] PDO type (0: RxPDO, 1: TxPDO).

Entry: [input] PDO mapping object subindex value (1 ~ 8).

EntryData: [input] A Double Word (4-byte) information of mapped application object. Users need to look up the user manual of the CANopen slave device to find the information of the application object, and obey the following example format to fill this parameter. **For Example, EntryData = 0x64110310:** Mapping to index 0x6411 and subindex 0x03 with data length 0x10 bit (2-byte).

If the function parameters are as following, **Cobid = 0x333**, **RxTx = 0**, **Entry = 2**, **EntryData = 0x64110310**. This example will map the 16-bit data of index 0x6411 and subindex 0x03 object to the 2nd entry of COB-ID 0x333 RxPDO.

BlockMode: [input] 0 means this function is non-block-function, and 1 means this function is block-function. If set this

parameter to 1, the running procedure of the users' application will be held in the function until return. If set to 0, this function will return "CPM_Processing" directly. This function will return its process status while users apply it with the same "SlotNo" and "Node" again. If the procedure is still not complete, it will return "CPM_Wait" .

3.5.38. I8123_RemovePDO

- **Description:**

The function I8123_RemovePDO can remove a TxPDO or RxPDO object had installed by the I8123_InstallPDO or I8123_AddNode. This function also can remove single object mapped in TxPDO or RxPDO.

- **Syntax:**

WORD I8123_RemovePDO(**BYTE** SlotNo, **BYTE** Node,
WORD Cobid, **BYTE** Entry,
BYTE BlockMode)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

Node: [input] Slave device Node-ID (1~127).

Cobid: [input] COB-ID used by the PDO object.

Entry: [input] PDO mapping object subindex value (0 ~ 8). If this value is set to 0, the specified PDO object will be removed. If others (1 ~ 8), the specified subindex content of the PDO will be removed.

BlockMode: [input] 0 means this function is non-block-function, and 1 means this function is block-function. If set this parameter to 1, the running procedure of the users' application will be held in the function until return. If set to 0, this function will return "CPM_Processing" directly. This function will return its process status while users apply it with the same "SlotNo" and "Node" again. If the procedure is still not complete, it will return "CPM_Wait" .

3.5.39. I8123_ChangePDOID

- **Description:**

Use the function I8123_ChangePDOID to change the PDO COB-ID from old "Old_Cobid" to new "New_Cobid" of a slave device.

- **Syntax:**

WORD I8123_ChangePDOID (**BYTE** SlotNo, **WORD** Old_Cobid,
WORD New_Cobid, **BYTE** BlockMode)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

Old_Cobid: [input] Old COB-ID used by the PDO object.

New_Cobid: [input] New COB-ID used by the PDO object.

BlockMode: [input] 0 means this function is non-block-function, and 1 means this function is block-function. If set this parameter to 1, the running procedure of the users' application will be held in the function until return. If set to 0, this function will return "CPM_Processing" directly. This function will return its process status while users apply it with the same "SlotNo" and "Old_Cobid" again. If the procedure is still not complete, it will return "CPM_Wait" .

3.5.40. I8123_GetPDOMapInfo

- **Description:**

The function I8123_GetPDOMapInfo can get the mapping data information of the PDO object.

- **Syntax:**

WORD I8123_GetPDOMapInfo (**BYTE** SlotNo, **WORD** Cobid,
WORD *PDONo, **BYTE** *RxTx, **BYTE** *Tx_Type,
WORD *Event_Timer, **BYTE** *Entry_Cnt,
DWORD *Map_Data, **BYTE** BlockMode)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

Cobid: [input] COB-ID used by the PDO object.

***PDONo:** [output] PDO mapping object No (1 ~ 512).

***RxTx:** [output] PDO type (0: RxPDO, 1: TxPDO).

***Tx_Type:** [output] Transmission type.

***Event_Timer:** [output] PDO event timer.

***Entry_Cnt:** [output] Useful PDO entry number of the PDO object.

***Map_Data:** [output] Double Word array parameter. Response the mapping data of the PDO object' s every useful entry.

BlockMode: [input] 0 means this function is non-block-function, and 1 means this function is block-function. If set this parameter to 1, the running procedure of the users' application will be held in the function until return. If set to 0, this function will return "CPM_Processing" directly. This function will return its process status while users apply it with the same "SlotNo" and "Cobid" again. If the procedure is still not complete, it will return "CPM_Wait" .

3.5.41. I8123_InstallPDO_List

- **Description:**

This function is similar with the I8123_InstallPDO function. It can install the old or new PDO object in the PDO object list of the I-8123W/I-9123. It is the same as I8123_InstallPDO. But the I8123_InstallPDO_List doesn't send any message to check if the PDO object exists in the real slave. It just changes the list in the memory of the I-8123W/I-9123. It means that user can use this function to install PDO and change PDO mapping data arbitrarily without disturbing the CANopen network. After using this function, the I-8123W/I-9123 will process the slave PDOs which have the same IDs configured by the function I8123_InstallPDO_List. It is very useful when the I-8123W/I-9123 is running in listen mode. User can use the function I8123_RemovePDO_List to remove the PDO object which is installed by I8123_InstallPDO_List.

- **Syntax:**

WORD I8123_InstallPDO_List (**BYTE** SlotNo, **BYTE** Node, **WORD** Cobid, **BYTE** RxTx, **WORD** PDO_No, **BYTE** Tx_Type, **WORD** EventTimer, **BYTE** EntryUse, **DWORD** *EntryData, **BYTE** BlockMode)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

Node: [input] Slave device Node-ID (1~127). If the "Node" parameter is the I-8123W/I-9123. Node-ID, the EntryUse and EntryData parameters are irrelevant. In this case, users can install their callback function to process received PDOs using I8123_InstallRxPDOISR or I8123_InstallRemotePDOISR for the I-8123W/I-9123.

Cobid: [input] COB-ID used by the PDO object.

RxTx: [input] PDO type (0: RxPDO, 1: TxPDO).

PDO_No: [input] PDO mapping object No (1 ~ 512).

Tx_Type: [input] Transmission type.

Event_Timer: [input] PDO event timer.

EntryUse: [input] Total entry of mapping object that will be installed.

***EntryData:** [input] Double Word array information of mapped application object. For example:

If the configuration is “**Cobid = 0x333, RxTx = 0, PDO_No = 10, Entry = 2, EntryData[0] = 0x64110310, EntryData[1] = 0x62000108**” , it will map the RxPDO10 with COB-ID 0x333. The 1st entry is 16-bit data of index 0x6411 and subindex 0x03 object and the 2nd entry is 8-bit data of index 0x6200 and subindex 0x01 object.

BlockMode: [input] 0 means this function is non-block-function, and 1 means this function is block-function. If set this parameter to 1, the running procedure of the users' application will be held in the function until return. If set to 0, this function will return “CPM_Processing” directly. This function will return its process status while users apply it with the same “SlotNo” and “Node” again. If the procedure is still not complete, it will return “CPM_Wait” .

3.5.42. I8123_RemovePDO_List

- **Description:**

The function I8123_RemovePDO_List can remove a TxPDO or RxPDO object had installed by the I8123_InstallPDO_List. This function also can remove single object mapped in the TxPDO or RxPDO.

- **Syntax:**

WORD I8123_RemovePDO_List(**BYTE** SlotNo, **BYTE** Node,
WORD Cobid, **BYTE** Entry,
BYTE BlockMode)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

Node: [input] Slave device Node-ID (1~127).

Cobid: [input] COB-ID used by the PDO object.

Entry: [input] PDO mapping object subindex value (0 ~ 8). If this parameter is set to 0, the specified PDO object will be removed. If others (1 ~ 8), the specified subindex content of the PDO will be removed.

BlockMode: [input] 0 means this function is non-block-function, and 1 means this function is block-function. If set this parameter to 1, the running procedure of the users' application will be held in the function until return. If set to 0, this function will return "CPM_Processing" directly. This function will return its process status while users apply it with the same "SlotNo" and "Node" again. If the procedure is still not complete, it will return "CPM_Wait" .

3.5.43. I8123_PDUseEntry

- **Description:**

Use this function to change the useful object mapping entry of PDO object. The useful entry starts from 1 to the parameter Entry. Therefore, if the parameter Entry is 0, it means that the PDO have no useful object mapping entry.

- **Syntax:**

WORD I8123_PDUseEntry (**BYTE** SlotNo, **WORD** Cobid,
BYTE Entry, **BYTE** BlockMode)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

Cobid: [input] COB-ID used by the PDO object.

Entry: [input] Useful entry number of PDO mapping object.

BlockMode: [input] 0 means this function is non-block-function, and 1 means this function is block-function. If set this parameter to 1, the running procedure of the users' application will be held in the function until return. If set to 0, this function will return "CPM_Processing" directly. This function will return its process status while users apply it with the same "SlotNo" and "Cobid" again. If the procedure is still not complete, it will return "CPM_Wait" .

3.5.44. I8123_PDOTxType

- **Description:**

Use this function to change transmission type of TxPDO. The default transmission type is 255.

- **Syntax:**

WORD I8123_PDOTxType(**BYTE** SlotNo, **WORD** Cobid,
BYTE Tx_Type, **BYTE** BlockMode)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

Cobid: [input] COB-ID used by the PDO object.

Tx_Type: [input] Transmission type of TxPDO (0 ~ 255).

Description of transmission type

Transmission type	PDO transmission				
	cyclic	acyclic	synchronous	asynchronous	RTR only
0		X	X		
1-240	X		X		
241-251	- reserved -				
252			X		X
253				X	X
254				X	
255				X	

BlockMode: [input] 0 means this function is non-block-function, and 1 means this function is block-function. If set this parameter to 1, the running procedure of the users' application will be held in the function until return. If set to 0, this function will return "CPM_Processing" directly. This function will return its process status while users apply it with the same "SlotNo" and "Cobid" again. If the procedure is still not complete, it will return "CPM_Wait" .

3.5.45. I8123_PDOEventTimer

- **Description:**

Use this function to change the event timer of the TxPDO. The default event timer is 0. When the event timer of the PDO object of the slave is more than 0, the PDO will be sent to master due to the parameter "Timer" automatically.

- **Syntax:**

WORD I8123_PDOEventTimer(**BYTE** SlotNo, **WORD** Cobid,
WORD Timer, **BYTE** BlockMode)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

Cobid: [input] COB-ID used by the PDO object.

Timer: [input] Event timer of TxPDO. The unit is millisecond.

BlockMode: [input] 0 means this function is non-block-function, and 1 means this function is block-function. If set this parameter to 1, the running procedure of the users' application will be held in the function until return. If set to 0, this function will return "CPM_Processing" directly. This function will return its process status while users apply it with the same "SlotNo" and "Cobid" again. If the procedure is still not complete, it will return "CPM_Wait" .

3.5.46. I8123_PDOInhibitTime

- **Description:**

Use this function to set the inhibit time to the TxPDO. This time is a minimum interval for PDO transmission.

- **Syntax:**

WORD I8123_PDOInhibitTime(**BYTE** SlotNo, **WORD** Cobid,
WORD Time, **BYTE** BlockMode)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

Cobid: [input] COB-ID used by the PDO object.

Time: [input] Inhibit time of TxPDO. The unit is millisecond.

BlockMode: [input] 0 means this function is non-block-function, and 1 means this function is block-function. If set this parameter to 1, the running procedure of the users' application will be held in the function until return. If set to 0, this function will return "CPM_Processing" directly. This function will return its process status while users apply it with the same "SlotNo" and "Cobid" again. If the procedure is still not complete, it will return "CPM_Wait" .

3.5.47. I8123_ChangeSYNCID

- **Description:**

Use the function I8123_ChangeSYNCID to change the SYNC COB-ID of a slave device.

- **Syntax:**

WORD I8123_ChangeSYNCID (**BYTE** SlotNo, **BYTE** Node,
WORD Cobid, **BYTE** BlockMode)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

Node: [input] Slave device Node-ID (1~127).

Cobid: [input] COB-ID used by the SYNC object.

BlockMode: [input] 0 means this function is non-block-function, and 1 means this function is block-function. If set this parameter to 1, the running procedure of the users' application will be held in the function until return. If set to 0, this function will return "CPM_Processing" directly. This function will return its process status while users apply it with the same "SlotNo" and "Cobid" again. If the procedure is still not complete, it will return "CPM_Wait" .

3.5.48. I8123_SetSYNC_List

- **Description:**

If the user uses I8123_AddNode function to add the slave with manual mode, the function I8123_SetSYNC_List must be called while the SYNC ID of the slave needs to be changed or be set. The function I8123_SetSYNC_List can only change the SYNC COB-ID in the COB-ID list of the I-8123W/I-9123, the real value stored in the slave device may be different from the configuration which is set by the function I8123_SetSYNC_List. The users need to confirm that by themselves.

- **Syntax:**

WORD I8123_SetSYNC_List (**BYTE** SlotNo, **BYTE** Node,
WORD Cobid, **BYTE** BlockMode)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

Node: [input] Slave device Node-ID (1~127).

Cobid: [input] COB-ID used by the SYNC object.

BlockMode: [input] 0 means this function is non-block-function, and 1 means this function is block-function. If set this parameter to 1, the running procedure of the users' application will be held in the function until return. If set to 0, this function will return "CPM_Processing" directly. This function will return its process status while users apply it with the same "SlotNo" and "Node" again. If the procedure is still not complete, it will return "CPM_Wait" .

3.5.49. I8123_GetSYNCID

- **Description:**

This function can get the SYNC ID from the COB-ID list of the I-8123W/I-9123.

- **Syntax:**

WORD I8123_GetSYNCID (**BYTE** SlotNo, **BYTE** Node,
WORD *Cobid, **BYTE** BlockMode)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

Node: [input] Slave device Node-ID (1~127).

***Cobid:** [output] Return the COB-ID used by the SYNC object.

BlockMode: [input] 0 means this function is non-block-function, and 1 means this function is block-function. If set this parameter to 1, the running procedure of the users' application will be held in the function until return. If set to 0, this function will return "CPM_Processing" directly. This function will return its process status while users apply it with the same "SlotNo" and "Node" again. If the procedure is still not complete, it will return "CPM_Wait" .

3.5.50. I8123_SendSYNCMsg

- **Description:**

Use the function I8123_SendSYNCMsg to send a SYNC message with specified COB-ID cyclically. If the parameter "Timer" is 0, the SYNC message will be stopped. If the parameter "Timer" is more than 0, the function will send SYNC message per "Timer" millisecond until finish the parameter "Times". When the "Times" is set to 0, the function will send SYNC message continuously until set "Timer" to 0. Users can set at most 5 SYNC messages with different ID to be sent cyclically.

- **Syntax:**

WORD I8123_SendSYNCMsg(**BYTE** SlotNo, **WORD** Cobid,
WORD Timer, **DWORD** Times, **BYTE** BlockMode)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

Cobid: [input] COB-ID used by the SYNC object.

Timer: [input] SYNC message transmission period. If the timer is 0, the SYNC message will be stopped.

Times: [input] SYNC message transmission times. If the time is 0, the SYNC message will be sending until "Timer" is set to 0.

BlockMode: [input] 0 means this function is non-block-function, and 1 means this function is block-function. If set this parameter to 1, the running procedure of the users' application will be held in the function until return. If set to 0, this function will return "CPM_Processing" directly. This function will return its process status while users apply it with the same "SlotNo" and "Cobid" again. If the procedure is still not complete, it will return "CPM_Wait".

3.5.51. I8123_GetCyclicSYNCInfo

- **Description:**

This function can get at most 5 SYNC messages information which have been configured by the function I8123_SendSYNCMsg. User can know what SYNC ID had been set.

- **Syntax:**

WORD I8123_GetCyclicSYNCInfo(**BYTE** SlotNo, **WORD** *Cobid,
WORD *Timer, **DWORD** *Times,
BYTE BlockMode)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

***Cobid:** [input] COB-ID array. Return most 5 SYNC ID.

***Timer:** [input] 5 WORD array. Each value is the cyclic period of the SYNC message.

***Times:** [input] 5 Double WORD array. Each one is the SYNC message sending times that set before.

BlockMode: [input] 0 means this function is non-block-function, and 1 means this function is block-function. If set this parameter to 1, the running procedure of the users' application will be held in the function until return. If set to 0, this function will return "CPM_Processing" directly. This function will return its process status while users apply it with the same "SlotNo" again. If the procedure is still not complete, it will return "CPM_Wait" .

3.5.52. I8123_ChangeEMCYID

- **Description:**

Use the function I8123_ChangeEMCYID to change the EMCY COB-ID of a specific slave device.

- **Syntax:**

WORD I8123_ChangeEMCYID (**BYTE** SlotNo, **BYTE** Node,
WORD Cobid, **BYTE** BlockMode)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

Node: [input] Slave device Node-ID (1~127).

Cobid: [input] COB-ID used by the EMCY object.

BlockMode: [input] 0 means this function is non-block-function, and 1 means this function is block-function. If set this parameter to 1, the running procedure of the users' application will be held in the function until return. If set to 0, this function will return "CPM_Processing" directly. This function will return its process status while users apply it with the same "SlotNo" and "Node" again. If the procedure is still not complete, it will return "CPM_Wait" .

3.5.53. I8123_SetEMCY_List

- **Description:**

If the user uses I8123_AddNode function to add the slave with manual mode, the function I8123_SetEMCY_List must be called while the EMCY ID of the slave needs to be changed or be set. I8123_SetEMCY_List only can change the EMCY COB-ID in the COB-ID list of the I-8123W/I-9123. Afterwards, the I-8123W/I-9123 process the EMCY messages with the specific EMCY COB-ID which is configured by the function I8123_SetEMCY_List.

- **Syntax:**

WORD I8123_SetEMCY_List (**BYTE** SlotNo, **BYTE** Node,
WORD Cobid, **BYTE** BlockMode)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

Node: [input] Slave device Node-ID (1~127).

Cobid: [input] COB-ID used by the EMCY object.

BlockMode: [input] 0 means this function is non-block-function, and 1 means this function is block-function. If set this parameter to 1, the running procedure of the users' application will be held in the function until return. If set to 0, this function will return "CPM_Processing" directly. This function will return its process status while users apply it with the same "SlotNo" and "Node" again. If the procedure is still not complete, it will return "CPM_Wait" .

3.5.54. I8123_GetEMCYID

- **Description:**

This function can get the EMCY ID from the COB-ID list of the I-8123W/I-9123.

- **Syntax:**

WORD I8123_GetEMCYID (**BYTE** SlotNo, **BYTE** Node,
WORD *Cobid, **BYTE** BlockMode)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

Node: [input] Slave device Node-ID (1~127).

***Cobid:** [output] Return the COB-ID used by the EMCY object.

BlockMode: [input] 0 means this function is non-block-function, and 1 means this function is block-function. If set this parameter to 1, the running procedure of the users' application will be held in the function until return. If set to 0, this function will return "CPM_Processing" directly. This function will return its process status while users apply it with the same "SlotNo" and "Node" again. If the procedure is still not complete, it will return "CPM_Wait" .

3.5.55. I8123_ReadLastEMCY

- **Description:**

This function can check if one slave had produced EMCY. If yes, this function will return the last EMCY message of the specific slave.

- **Syntax:**

WORD I8123_ReadLastEMCY (**BYTE** SlotNo, **BYTE** Node,
BYTE *IsNew, **BYTE** *RData,
BYTE BlockMode)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

Node: [input] Slave device Node-ID (1~127).

***IsNew:** [output] Check the data if had been read before. 0 is been read before, and 1 is new one.

***RData:** [output] 8-byte EMCY message gets from the EMCY buffer.

BlockMode: [input] 0 means this function is non-block-function, and 1 means this function is block-function. If set this parameter to 1, the running procedure of the users' application will be held in the function until return. If set to 0, this function will return "CPM_Processing" directly. This function will return its process status while users apply it with the same "SlotNo" and "Node" again. If the procedure is still not complete, it will return "CPM_Wait" .

3.5.56. I8123_GetBootUpNodeAfterAdd

- **Description:**

If users don't know that which slave node occurred the boot-up message and which I-8123W/I-9123 received it. Users can use the function I8123_GetBootUpNodeAfterAdd. This function can get not only the slave node ID but also the slot number of the I-8123W/I-9123. The parameter, SlotNo, indicates the number of the I-8123W/I-9123 which receives the boot-up message. The parameter, Node, is the ID of the slave node which produces the boot-up message. The I8123_GetBootUpNodeAfterAdd function is usually applied with the function I8123_InstallBootUpISR. But note that, this function can only get the slave node ID that has already been added (I8123_AddNode) to the I-8123W/I-9123.

- **Syntax:**

```
WORD I8123_GetBootUpNodeAfterAdd(BYTE *SlotNo,  
                                BYTE *Node)
```

- **Parameter:**

*SlotNo: [output] Get the slot number of the I-8123W which receives the boot-up message.

*Node: [output] Get the slave node ID of the received boot-up message.

3.5.57. I8123_GetEMCYData

- **Description:**

If users don't know that which slave node occurred the EMCY message and which I-8123W/I-9123 received it. Users can use the function I8123_GetEMCYData. This function can get not only the EMCY message with the slave node ID but also the slot number of the I-8123W/I-9123. The parameter, SlotNo, indicates the number of the I-8123W/I-9123 which receives the EMCY message. The parameter, Node, is the ID of the slave node which produces the EMCY. The parameters, *RData, is the 8-bytes EMCY message data. The function I8123_GetEMCYData is usually applied with the function I8123_InstallEMCYISR. About the demo please refer to the section 4.1.2 NMT_Protocol.

- **Syntax:**

WORD I8123_GetEMCYData (**BYTE** *SlotNo, **BYTE** *Node,
BYTE *RData)

- **Parameter:**

***SlotNo:** [output] Get the slot number of the I-8123W/I-9123 which receives the EMCY message.

***Node:** [output] Get the slave node ID of the received EMCY message.

***RData:** [output] 8-byte EMCY message obtained from the EMCY buffer.

3.5.58. I8123_GetNMTErr

- **Description:**

User can use the function I8123_GetNMTErr to check if the I-8123W/I-9123 gets NMT Error Event for any slave node. The parameters of the function indicate that which I-8123W/I-9123 gets the NMT Error Event, which node produces this event, and what kind of event it is. The parameter, SlotNo, indicates the number of the I-8123W/I-9123 which indicates the Heartbeat_Event or Node_Guarding_Event. The parameter, Node, is the ID of the slave node which responds the heartbeat protocol or guarding protocol. The parameter, NMTErr, is the NMTErr event mode. If the NMTErr event is Node_Guarding_Event, the NMTErr parameter is CPM_Node_Guarding_Event or else the CPM_Heartbeat_Event is obtained. The function I8123_GetNMTErr is usually applied with the function I8123_InstallNMTErrISR. About the demo please refer to the section 4.1.2 NMT_Protocol.

- **Syntax:**

WORD I8123_GetNMTErr (**BYTE** *SlotNo, **BYTE** *Node,
BYTE *NMTErr)

- **Parameter:**

***SlotNo:** [output] Get the slot number of the I-8123W/I-9123 which receives the NMT Error Event.

***Node:** [output] Get the slave node ID of the NMT Error Event.

***NMTErr:** [output] The value CPM_Node_Guarding_Event indicates the Node Guarding Event, and the CPM_Heartbeat_Event is the Heartbeat Event.

3.5.59. I8123_InstallBootUpISR

- **Description:**

This function allows the user to apply the slave boot-up IST (interrupt service thread). When the user puts his boot-up process into this function, all the boot-up triggered by the slaves will go to the boot-up IST. If the boot-up message of a slave which has been added to the I-8123W /I-9123 is happen, the I-8123W/I-9123 will go into the boot-up process to do some specified mechanism which follows the user' s boot-up process.

- **Syntax:**

WORD I8123_InstallBooUpISR(**BYTE** SlotNo, **void** (*BOOTISR)())

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

(*BOOTISR)(): [input] The pointer which points a function with format "void XXX()" . The XXX is the function name of the user' s boot-up process. This process is usually applied with the function I8123_GetBootUpNodeAfterAdd.

3.5.60. I8123_RemoveBootUpISR

- **Description:**

When the user doesn't need the boot-up IST function, call this function to remove the user's IST.

- **Syntax:**

WORD I8123_RemoveBootUpISR(**BYTE** SlotNo)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

3.5.61. I8123_InstallEMCYISR

- **Description:**

This function allows the user to apply the EMCY IST (interrupt service thread). When the user puts his EMCY process into this function, all the EMCY triggered by the slaves will go to the EMCY IST. If the EMCY of a slave is happen, the I-8123W/I-9123 will go into the EMCY process to do some security mechanism which follows the user' s EMCY process.

- **Syntax:**

WORD I8123_InstallEMCYISR(**BYTE** SlotNo, **void** (*EMCYISR)())

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

(*EMCYISR)(): [input] The pointer which points a function with format "void XXX()" . The XXX is the function name of the user' s EMCY process. This process is usually applied with the function I8123_GetEMCYData.

3.5.62. I8123_RemoveEMCYISR

- **Description:**

When the user doesn't need the EMCY IST function, call this function to remove the user's IST.

- **Syntax:**

WORD I8123_RemoveEMCYISR(**BYTE** SlotNo)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

3.5.63. I8123_InstallNMErrISR

- **Description:**

This function allows the user to apply NMTErr IST (interrupt service thread). When the user puts his NMTErr process into this function, all the Heartbeat_Event and Node_Guarding_Event triggered by the slaves will go to the IST. If the user had used the I8123_NMTGuarding to enable the guarding protocol or had used the I8123_Heartbeat to enable the heartbeat protocol, the I-8123W/I-9123 will go into the NMTErr IST to do the user's NMTErr process while the guarding confirms or heartbeat indicator doesn't be received.

- **Syntax:**

WORD I8123_InstallNMErrISR(**BYTE** SlotNo, **void** (*NMTErrISR)())

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

(*NMTErrISR) (): [input] The pointer which points a function with format "void XXX()" . The XXX is the function name of the user's process. This process is usually applied with the function I8123_GetNMTErr.

3.5.64. I8123_RemoveNMTErrISR

- **Description:**

When the user doesn't need the NMTErr IST function, call this function to remove the user's IST.

- **Syntax:**

WORD I8123_RemoveNMTErrISR(**BYTE** SlotNo)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

3.5.65. I8123_GetMasterReadSDOEvent

- **Description:**

Using this function can get all the read SDO messages sent to the specific node ID of the I-8123W/I-9123. For example, the I-8123W/I-9123 is initialized with node ID 2. If someone sends an SDO message with the COB-ID 0x602 to the I-8123W/I-9123 for reading an object, users can use the function I8123_GetMasterReadSDOEvent for obtaining this SDO message, and respond some information to the SDO sender. The parameter, SlotNo, indicates the number of the I-8123W /I-9123 which receives the read SDO message. The parameters, Index and SubIndex, are the object indicator. The function I8123_GetMasterReadSDOEvent is usually applied with the function I8123_InstallReadSDOISR. About the demo please refer to the section 4.1.6 SDO_PDO_ISR.

Note: The function is valid while the Node parameter of the function I8123_InitMaster is > 0.

- **Syntax:**

WORD I8123_GetMasterReadSDOEvent (BYTE *SlotNo,
WORD *Index, BYTE *SubIndex)

- **Parameter:**

*SlotNo: [output] Get the slot number of the I-8123W/I-9123 which receives the read SDO message.

*Index: [output] Get the object index of the SDO message.

*SubIndex: [output] Get the object subindex of the SDO message.

3.5.66. I8123_GetMasterWriteSDOEvent

- **Description:**

Using this function can get all the write SDO messages sent to the specific node ID of the I-8123W/I-9123. For example, the I-8123W/I-9123 is initialized with node ID 2. If someone sends an SDO message with the COB-ID 0x602 to the I-8123W/I-9123 for writing an object, users can use the function I8123_GetMasterWriteSDOEvent for obtaining this SDO message. The parameter, SlotNo, indicates the number of the I-8123W/I-9123 which receives the write SDO message. The parameters, Index and SubIndex, are the object indicator. The parameter WLen is the data length of the parameter *WData. The function I8123_GetMasterWriteSDOEvent is usually applied with the function I8123_InstallWriteSDOISR. About the demo please refer to the section 4.1.6 SDO_PDO_ISR.

Note: The function is valid while the Node parameter of the function I8123_InitMaster is > 0.

- **Syntax:**

WORD I8123_GetMasterWriteSDOEvent (**BYTE** *SlotNo,
WORD *Index, **BYTE** *SubIndex,
BYTE *WLen, **BYTE** *WData)

- **Parameter:**

***SlotNo:** [output] Get the slot number of the I-8123W/I-9123 which receives the write SDO message.

***Index:** [output] Get the object index of the SDO message.

***SubIndex:** [output] Get the object subindex of the SDO message.

***WLen:** [output] The data length of the write data.

***WData:** [output] Return 0~4 bytes of the SDO write data.

3.5.67. I8123_ResponseMasterSDO

- **Description:**

To reply to SDO messages from an SDO sender, use the I8123_ResponseMasterSDO function. For instance, if the I-8123W/I-9123 is initialized with Node ID 2, and an SDO message with COB-ID 0x602 is received to read or write an object, the I-8123W/I-9123 must respond using this function. Upon execution, the I-8123W/I-9123 sends an SDO message with COB-ID 0x582 back to the CANopen network. This function is typically used with the SDO ISR series functions. For an example, refer to section 4.1.6, SDO_PDO_ISR, in the demo documentation.

Note1: The function is valid while the Node parameter of the function I8123_InitMaster is > 0.

Note2: If the I-8123W/I-9123 want to reply a SDO Abort message, please use I8123_SDOAbortTransmit (section 3.5.20) to do it.

- **Syntax:**

WORD I8123_ResponseMasterSDO (**BYTE** SlotNo, **BYTE** ResType,
WORD Index, **BYTE** SubIndex,
BYTE Len, **BYTE** *Data)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

ResType: [input] Response type of SDO message, 0 for replying the read SDO message and 1 for the write SDO message.

Index: [input] Object index of object dictionary of slave devices.

SubIndex: [input] Subindex of the object index.

Len: [input] The data length of the response data. If the ResType is 1 (write type), the Len and *Data parameter is useless.

***Data:** [input] Return 0~4 bytes of the SDO response data.

3.5.68. I8123_InstallReadSDOISR

- **Description:**

This function allows the user to apply the ReadSDO IST (interrupt service thread) of I-8123W/I-9123. When the user puts his read SDO process into this function, all the read SDO messages sent to the specified I-8123W/I-9123 will trigger the IST. For example, the I-8123W /I-9123 is initialized with node ID 2. If someone sends an SDO message with the COB-ID 0x602 for reading the object of the I-8123W/I-9123, the I-8123W/I-9123 will go into the IST if the user has installed it.

Note: The function is valid while the Node parameter of the function I8123_InitMaster is > 0.

- **Syntax:**

WORD I8123_InstallReadSDOISR(**BYTE** SlotNo, **void** (*RSDOISR)())

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

(*RSDOISR)(): [input] The pointer which points a function with format "void XXX()" . The XXX is the function name of the user' s process. This process is usually used with the function I8123_GetMasterReadSDOEvent.

3.5.69. I8123_RemoveReadSDOISR

- **Description:**

When the user doesn't need the ReadSDO IST function, call this function to remove the user IST.

- **Syntax:**

WORD I8123_RemoveReadSDOISR(**BYTE** SlotNo)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

3.5.70. I8123_InstallWriteSDOISR

- **Description:**

This function allows the user to apply the WriteSDO IST (interrupt service routine) of the I-8123W/I-9123. When the user puts the process into this function, all the written SDO messages sent to the specified I-8123W/I-9123 will trigger the IST. For example, the I-8123W/I-9123 is initialized with node ID 2. If someone sends an SDO message with the COB-ID 0x602 to the I-8123W/I-9123 for writing an object, the I-8123W/I-9123 will go into the IST if the user has installed it.

Note: The function is valid while the Node parameter of the function I8123_InitMaster is > 0.

- **Syntax:**

WORD I8123_InstallWriteSDOISR(**BYTE** SlotNo, **void** (*WSDOISR)())

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

(*WSDOISR)(): [input] The pointer which points a function with format "void XXX()" . The XXX is the function name of user' s process. This process is usually used with the function I8123_GetMasterWriteSDOEvent.

3.5.71. I8123_RemoveWriteSDOISR

- **Description:**

When the user doesn't need the WriteSDO IST function, call this function to remove the user IST.

- **Syntax:**

WORD I8123_RemoveWriteSDOISR(**BYTE** SlotNo)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

3.5.72. I8123_GetMasterRemotePDOEvent

- **Description:**

Using this function can get all the Remote PDO messages sent to the I-8123W/I-9123. For example, the I-8123W/I-9123 has used the function I8123_InstallPDO_List to install an I-8123W/I-9123' s TxPDO object with the COB-ID 0x444. If someone sends a Remote PDO message with the COB-ID 0x444 to the I-8123W/I-9123, users can use the function I8123_GetMasterRemotePDOEvent to get this PDO message. The parameter, SlotNo, indicates the number of the I-8123W /I-9123which receives the Remote PDO message. The parameter, Cobid, is the PDO COB-ID sent to the I-8123W/I-9123. This function is usually used with the function I8123_InstallRemotePDOISR. About the demo please refer to the section 4.1.6 SDO_PDO_ISR.

Note: The function is valid while the Node parameter of the function I8123_InitMaster is > 0.

- **Syntax:**

WORD I8123_GetMasterRemotePDOEvent (**BYTE** *SlotNo,
WORD *CobId)

- **Parameter:**

***SlotNo:** [output] Get the slot number of the I-8123W/I-9123 which receives the Remote PDO message.

***CobId:** [output] Return the COB-ID of the Remote PDO message.

3.5.73. I8123_GetMasterRxPDOEvent

- **Description:**

Using this function can get all the RxPDO messages sent to the I-8123W/I-9123. For example, the I-8123W/I-9123 has used the function I8123_InstallPDO_List to install an I-8123W/I-9123 's RxPDO object with the COB-ID 0x333. If someone sends an RxPDO message with the COB-ID 0x333 to the I-8123W/I-9123, users can use this function to get this RxPDO message. The parameter, SlotNo, indicates the number of the I-8123W/I-9123 which receives the RxPDO message. The parameter, Cobid, is the RxPDO COB-ID ID. The two parameters, *WLen and *WData, are the data length and contents of the RxPDO message. This function is usually applied with the function I8123_InstallRxPDOISR. About the demo please refer to the section 4.1.6 SDO_PDO_ISR.

Note: The function is valid while the Node parameter of the function I8123_InitMaster is > 0.

- **Syntax:**

WORD I8123_GetMasterRxPDOEvent (BYTE *SlotNo,
WORD *CobId, BYTE *WLen,
BYTE *WData)

- **Parameter:**

*SlotNo: [output] Get the slot number of the I-8123W/I-9123 which receives the RxPDO message.

*CobId: [output] Return the RxPDO COB-ID.

*WLen: [output] The data length of the RxPDO data.

*WData: [output] Return 0~4 bytes of the RxPDO data.

3.5.74. I8123_ResponseMasterPDO

- **Description:**

Using this function can reply the Remote PDO messages to the sender. For example, the I-8123W/I-9123 has used I8123_InstallPDO_List to install a TxPDO object with the COB-ID 0x444. If someone sends a Remote PDO message with the COB-ID 0x444 to the I-8123W/I-9123, and the I-8123W/I-9123 needs to reply a TxPDO message, users can use this function to do it. When users implement the function I8123_ResponseMasterPDO, the I-8123W/I-9123 will send a TxPDO message to the CANopen network. This function is usually used with the I8123_InstallRemotePDOISR function. About the demo please refer to the section 4.1.6 SDO_PDO_ISR.

Note: The function is valid while the Node parameter of the function I8123_InitMaster is > 0.

- **Syntax:**

WORD I8123_ResponseMasterPDO (**BYTE** SlotNo, **WORD** CobId,
BYTE Len, **BYTE** *Data)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

CobId: [input] TxPDO COB-ID for replying the PDO message.

Len: [input] The data length of the response data.

***Data:** [input] Return the COB-ID of the TxPDO PDO message.

3.5.75. I8123_InstallRxPDOISR

- **Description:**

This function allows the user to apply the RxPDO IST (interrupt service routine) of the I-8123W/I-9123. When the user puts his process into this function, all the RxPDO messages with the I-8123W/I-9123's PDO objects will trigger the IST. For example, the I-8123W/I-9123 has used I8123_InstallPDO_List to install a PDO object with the COB-ID 0x333 of the I-8123W/I-9123. If someone sends a PDO message with the COB-ID 0x333 to the I-8123W/I-9123, the I-8123W/I-9123 will go into the IST if the user had installed it.

Note: The function will usefully when the Node parameter of the function I8123_InitMaster is > 0.

- **Syntax:**

WORD I8123_InstallRxPDOISR(**BYTE** SlotNo, **void** (*RXPDOISR)())

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

(*RXPDOISR)(): [input] The pointer which points a function with format "void XXX()" . The XXX is the function name of user's process. This process is usually used with the function I8123_GetMasterRxPDOEvent.

3.5.76. I8123_RemoveRxPDOISR

- **Description:**

When the user doesn't need the RxPDO IST function, call this function to remove the user IST.

- **Syntax:**

WORD I8123_RemoveRxPDOISR(**BYTE** SlotNo)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

3.5.77. I8123_InstallRemotePDOISR

- **Description:**

This function allows the user to apply the RemotePDO IST (interrupt service routine) of the I-8123W/I-9123. When the user puts his process into this function, all the Remote PDO messages of the I-8123W/I-9123's PDO objects will trigger the IST. For example, the I-8123W/I-9123 has used I8123_InstallPDO_List to install a TxPDO object with the COB-ID 0x444 of the I-8123W/I-9123. If some one sends a Remote PDO message with the COB-ID 0x444 to the I-8123W/I-9123, the I-8123W/I-9123 will go into the IST if the user had installed it.

Note: The function will usefully when the Node parameter of the function I8123_InitMaster is > 0.

- **Syntax:**

```
WORD I8123_InstallRemotePDOISR(BYTE SlotNo,  
                               void (*REMOTEPDOISR)())
```

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

(*REMOTEPDOISR)(): [input] The pointer which points a function with format "void XXX()" . The XXX is the function name of user's process. This process is usually used with the function I8123_GetMasterRemotePDOEvent.

3.5.78. I8123_RemoveRemotePDOISR

- **Description:**

When the user doesn't need the RemotePDO IST function, call this function to remove the user IST.

- **Syntax:**

WORD I8123_RemoveRemotePDOISR(**BYTE** SlotNo)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

3.5.79. I8123_SyncGroupCycUpdata

- **Description:**

Before use I8123_SyncGroupCycSend to send SYNC and PDO group data, user should use this function to fill the Max 15 cycle buffer. If users want their devices run more group cycles, users can still use this function to continuously fill the cycle buffer after execute I8123_SyncGroupCycSend.

- **Syntax:**

WORD I8123_SyncGroupCycUpdata(**BYTE** SlotNo, **BYTE** StepNum, **BYTE** RecordNum, **WORD** *PDOId, **BYTE** *GroupData, **BYTE** BlockMode)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

StepNum: [input] Cycle number of this update (<= 15).

RecordNum: [input] PDO numbers of this SYNC group. Every update, the PDO numbers of the group data must be the same. This parameter is < 32 (RecordNum * StepNum < 60).

***PDOId:** [input] PDO ID array of these group data. The array size is according to parameter RecordNum.

***GroupData:** [input] PDO group data buffer. Reserved 8-byte buffer for each PDO. Array size is "RecordNum * StepNum * 8" .

BlockMode: [input] 0 means this function is non-block-function, and 1 means this function is block-function. If set this parameter to 1, the running procedure of the users' application will be held in the function until return. If set to 0, this function will return "CPM_Processing" directly. This function will return its process status while users apply it with the same "BoardNo" again. If the procedure is still not complete, it will return "CPM_Wait" .

3.5.80. I8123_SyncGroupCycSend

- **Description:**

Use this function start to send SYNC and PDO group data from group cycle buffer (updated by I8123_SyncGroupCycUpdata).

- **Syntax:**

WORD I8123_SyncGroupCycSend(**BYTE** SlotNo,
DWORD TotalCycle, **DWORD** CycInterval,
BYTE BlockMode)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

TotalCycle: [input] Total cycle of these SYNC group mission.

TotalCycle = 0 means unlimited.

CycInterval: [input] Cycle timer, unit is 0.1 ms and minimum value is 5 (0.5 ms).

BlockMode: [input] 0 means this function is non-block-function, and 1 means this function is block-function. If set this parameter to 1, the running procedure of the users' application will be held in the function until return. If set to 0, this function will return "CPM_Processing" directly. This function will return its process status while users apply it with the same "BoardNo" again. If the procedure is still not complete, it will return "CPM_Wait" .

3.5.81. I8123_SyncGroupClear

- **Description:**

Use this function to clear all the SYNC and PDO group data in group cycle buffer (updated by I8123_SyncGroupCycUpdata). If the last SYNC group is stopped for some problem, before start the next new SYNC group data, recommend use this function to clear the group data buffer first.

- **Syntax:**

WORD I8123_SyncGroupClear(**BYTE** SlotNo, **BYTE** BlockMode)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

BlockMode: [input] 0 means this function is non-block-function, and 1 means this function is block-function. If set this parameter to 1, the running procedure of the users' application will be held in the function until return. If set to 0, this function will return "CPM_Processing" directly. This function will return its process status while users apply it with the same "BoardNo" again. If the procedure is still not complete, it will return "CPM_Wait" .

3.5.82. I8123_GetSYNCGroupStopState

- **Description:**

Use this function to get stop state of the SYNC and PDO group data. This function can use with SYNCISR user-defined function (please refer to 4.5.86 I8123_InstallSYNCGroupISR).

- **Syntax:**

WORD I8123_GetSyncGroupStopState(**BYTE** *SlotNo, **BYTE** *State)

- **Parameter:**

*SlotNo: [output] Get the slot number of the I8123/I-9123 which receives the stop state.

*State: [output] 1: SYNC and PDO group data send complete.
2: SYNC and PDO group data is stopped by send fail.

3.5.83. I8123_InstallSYNCGroupISR

- **Description:**

This function allows the user to apply the SYNCGroup IST (interrupt service routine) of the I-8123W. When the user puts his process into this function, if the SYNC and PDO group data is stopped or completed, a SYNC group stop state event will trigger the IST.

- **Syntax:**

```
WORD I8123_InstallSYNCGroupISR(BYTE SlotNo,  
                                void (*SYNCISR())
```

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

***SYNCISR:** [input] The pointer which points a function with format "void XXX()" . The XXX is the function name of user' s process. This process is usually used with the function I8123_GetSyncGroupStopState.

3.5.84. I8123_RemoveSYNCGroupISR

- **Description:**

When the user doesn't need the SYNCGroup IST function, call this function to remove the user IST.

- **Syntax:**

WORD I8123_RemoveSYNCGroupISR(**BYTE** SlotNo)

- **Parameter:**

SlotNo: [input] I-8123W/I-9123 slot number (0~7).

4. Demo Programs

The I-8123W/I-9123 provides 10 demos of the various applications for NMT protocol, SDO protocol, PDO protocol, NMT Error IST...etc. All these demos support eVC++ 4.0, VB.net 2005, and C# 2005. There is also a tool, CPMUtility, to control/monitor CANopen slaves with I-8123W/I-9123 easily and quickly. Users can find these demos and utility tool in the fieldbus CD or on the web site.

The address of the web site

I-8123W: <https://www.icpdas.com/en/product/I-8123W-G>


I-9123: <https://www.icpdas.com/en/product/I-9123>

4.1. Brief of the demo programs

These demo programs are developed for demonstrating how to use the CANopen master library to apply the general CANopen communication protocol. These demo programs provide the SDO, PDO, NMT, SYNC communication applications. Each demo program includes some functions of the CANopen master library. The relationship between CANopen master library functions and demo programs are displayed in the following description.

4.1.1. Listen_Mode

Initialize the I-8123W/I-9123 with the “listen mode” and add slave nodes with the “manual mode”, then the I-8123W/I-9123 listens CANopen messages only and does not send any message to the CANopen network. In this demo, the I-8123W/I-9123 will listen NMT state, 4 TxPDO messages (with the COB ID 0x180+Node ID, 0x280+Node ID, 0x380+Node ID, and 0x480+Node ID), 4 RxPDO messages (with the COB ID 0x200+Node ID, 0x300+Node ID, 0x400+Node ID, and 0x500+Node ID), and the EMCY messages.

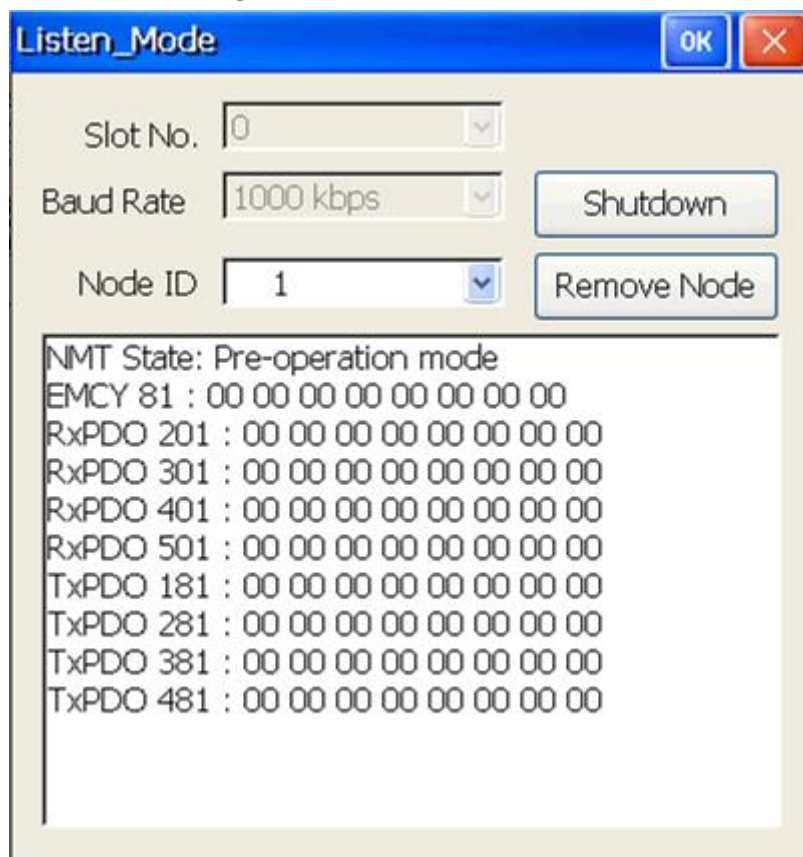

Applied function list:

[I8123_InitMaster](#), [I8123_Shutdown](#), [I8123_AddNode](#),
[I8123_RemoveNode](#), [I8123_EDS_Load](#), [I8123_SetMasterMode](#),
[I8123_NMTGetState](#), [I8123_InstallPDO_List](#), [I8123_GetPDOLastData](#),
[I8123_GetRxPDOID](#), [I8123_GetTxPDOID](#), [I8123_SetEMCY_List](#),
[I8123_GetEMCYID](#), [I8123_ReadLastEMCY](#).

4.1.2. NMT_Protocol

This is a NMT network control demo. The demo not only tells users how to control the NMT status of a specific slave node, but also how to protect the slave through the “Guarding” and “Heartbeat” functions.

The screenshot shows a software window titled "NMT_Protocol" with standard Windows window controls (OK, X). The interface includes several configuration options:

- Slot No.:** A dropdown menu currently set to 0.
- Baud Rate:** A dropdown menu currently set to 1000 kbps.
- Node:** A dropdown menu currently set to 1.
- Node State:** A dropdown menu currently set to Operation.
- Guarding Time:** A text input field containing 1000.
- Life:** A text input field containing 2.
- Heartbeat (ms):** A text input field containing 1000.
- Consumer (ms):** A text input field containing 2500.


On the right side of the window, there are several action buttons: Shutdown, Remove Node, Set Status, Set Guarding, and Set Heartbeat. At the bottom, there is a text area displaying "EMCY: 00 00 00 00 00 00 00 00" and a Clear button.

Applied function list:

[I8123_InitMaster](#), [I8123_Shutdown](#), [I8123_AddNode](#),
[I8123_RemoveNode](#), [I8123_NMTChangeState](#), [I8123_NMTGuarding](#),
[I8123_NMTHeartbeat](#), [I8123_GetEMCYData](#), [I8123_GetNMTErr](#),
[I8123_InstallNMTErrISR](#), [I8123_RemoveNMTErrISR](#), [I8123_InstallEMCYISR](#),
[I8123_RemoveEMCYISR](#).

4.1.3. PDO_Parameter

Sometimes, the default PDO configuration can't satisfy users. Users need to change the configuration of the PDO related parameters such as transmission type, PDO ID, event timer, dynamic PDO, and so forth. This demo will demonstrate how to change settings of these PDO parameters and show the configuration result.

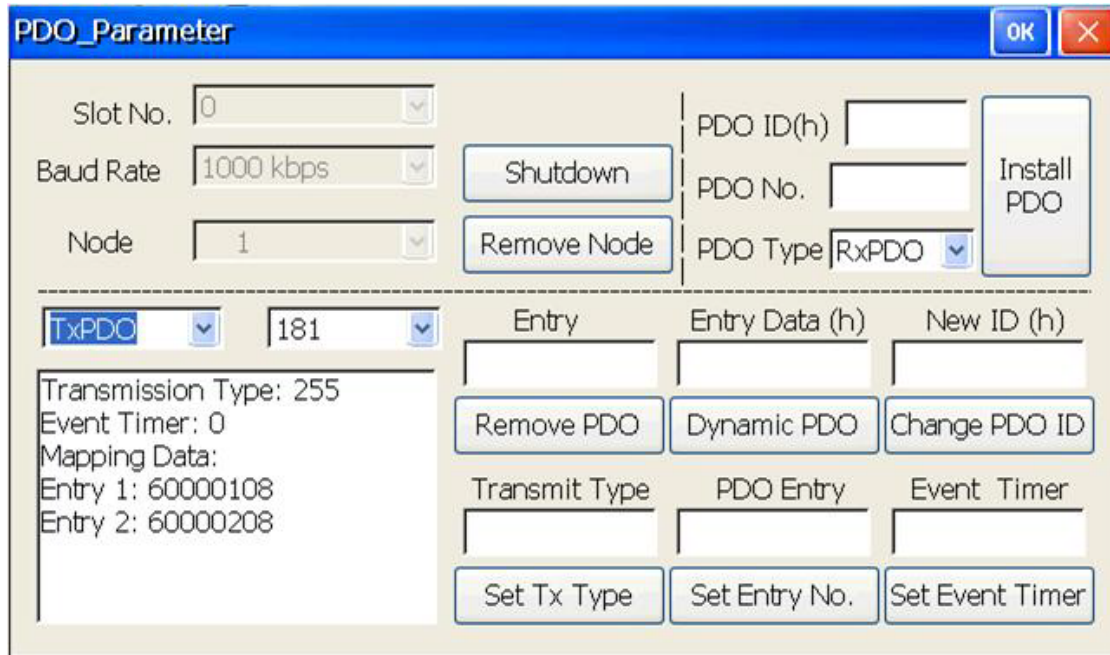


Applied function list:

[I8123_InitMaster](#), [I8123_Shutdown](#), [I8123_AddNode](#),
[I8123_RemoveNode](#), [I8123_InstallPDO](#), [I8123_RemovePDO](#),
[I8123_DynamicPDO](#), [I8123_ChangePDOID](#), [I8123_PDOTxType](#),
[I8123_PDOWUseEntry](#), [I8123_PDOWEventTimer](#), [I8123_GetTxPDOID](#),
[I8123_GetRxPDOID](#), [I8123_GetPDOMapInfo](#).

4.1.4. PDO_Protocol

The PDO protocol is the main protocol to control the I/O of the specific slave device in the CANopen network. This demo shows how to read and write data to the slave device with the PDO functions.

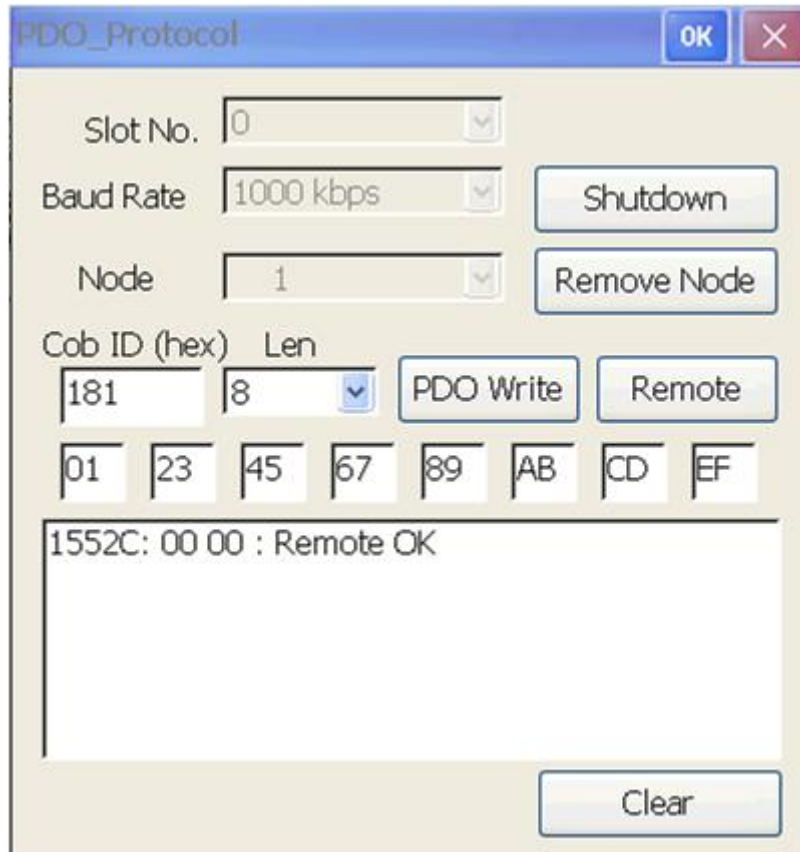


Applied function list:

[I8123_InitMaster](#), [I8123_Shutdown](#), [I8123_AddNode](#),
[I8123_RemoveNode](#), [I8123_PDOWrite](#), [I8123_PDORemote](#),
[I8123_GetPDOLastData](#)

4.1.5. Scan_Node

When users want to know which slave nodes exist on the CANopen network or which slave nodes are under the control of the I-8123W/I-9123, this demo will is useful.

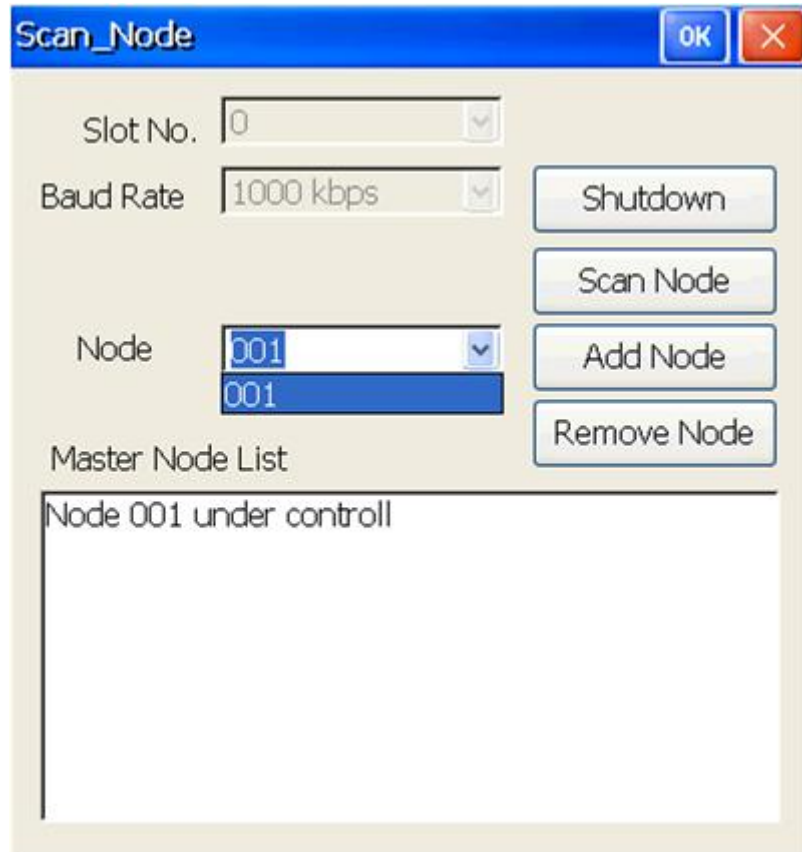


Applied function list:

[I8123_InitMaster](#), [I8123_Shutdown](#), [I8123_AddNode](#),
[I8123_RemoveNode](#), [I8123_SetFunctionTimeout](#), [I8123_ScanNode](#),
[I8123_GetNodeList](#)

4.1.6. SDO_PDO_ISR

In this demo, it is allowed to configure the I-8123W/I-9123 as a CANopen slave. Users can use another CANopen master to read/write the users' defined object dictionary of the I-8123W/I-9123 by SDO protocol or to get/set the DIO status by PDO protocol when the I-8123W/I-9123, the I-8053W DI module, and the I-8057W DO module are plugged in the same MCU. If the user has an application like this, this demo may be a good reference.

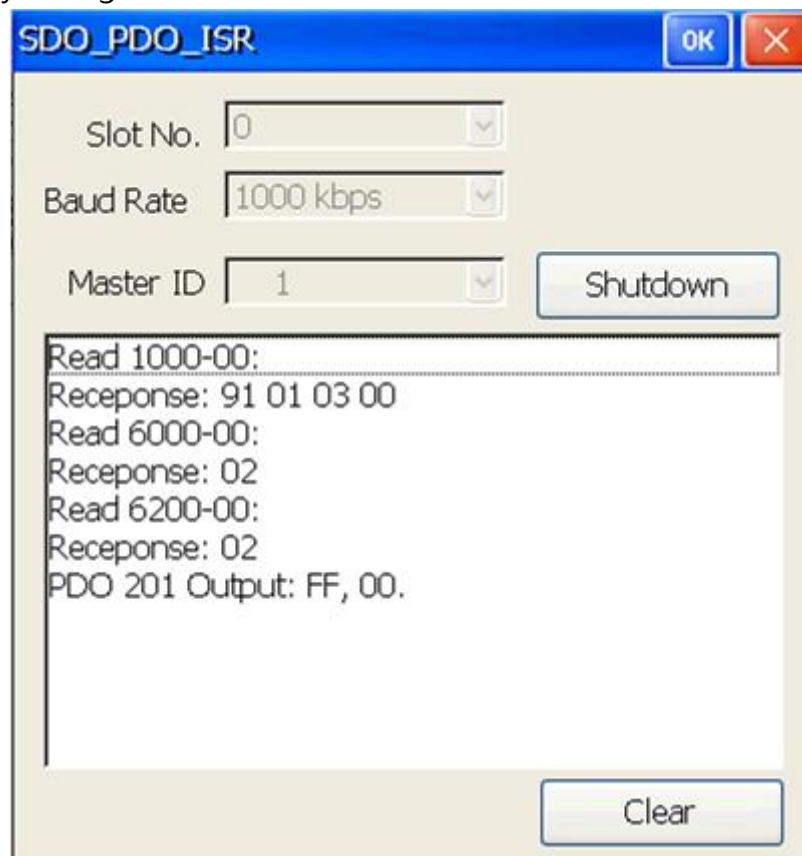


Applied function list:

[I8123_InitMaster](#), [I8123_Shutdown](#), [I8123_GetMasterReadSDOEvent](#),
[I8123_GetMasterWriteSDOEvent](#), [I8123_GetMasterRemotePDOEvent](#),
[I8123_GetMasterRxPDOEvent](#), [I8123_ResponseMasterSDO](#),
[I8123_ResponseMasterPDO](#), [I8123_InstallPDO_List](#),
[I8123_InstallReadSDOISR](#), [I8123_InstallWriteSDOISR](#),
[I8123_InstallRxPDOISR](#), [I8123_InstallRemotePDOISR](#).

4.1.7. SDO_Read

SDO protocol is a kind of the communication functions used to read/write CANopen object dictionary. You can read any object data of the object dictionary through the object address (index and sub-index) by SDO protocol. This demo is a good model to do that.

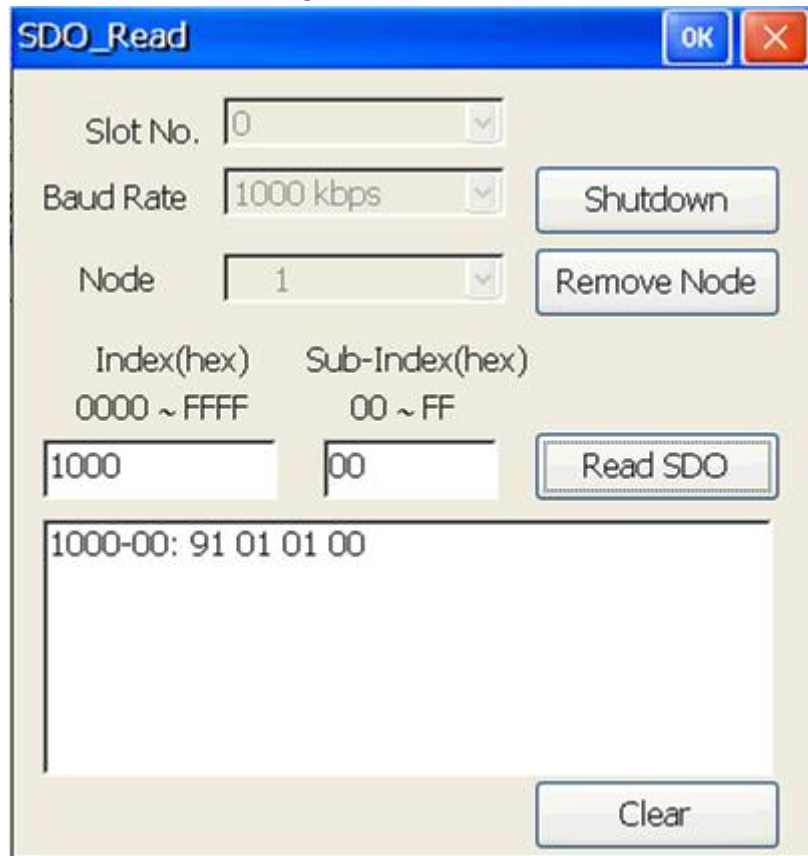


Applied function list:

[I8123_InitMaster](#), [I8123_Shutdown](#), [I8123_AddNode](#),
[I8123_RemoveNode](#), [I8123_SDOReadData](#).

4.1.8. SDO_Write

SDO protocol is a kind of the communication functions used to read/write CANopen object dictionary. You can write any data to the specific object of the object dictionary through the object address (index and sub-index) by SDO protocol. This demo is a good model to do that.

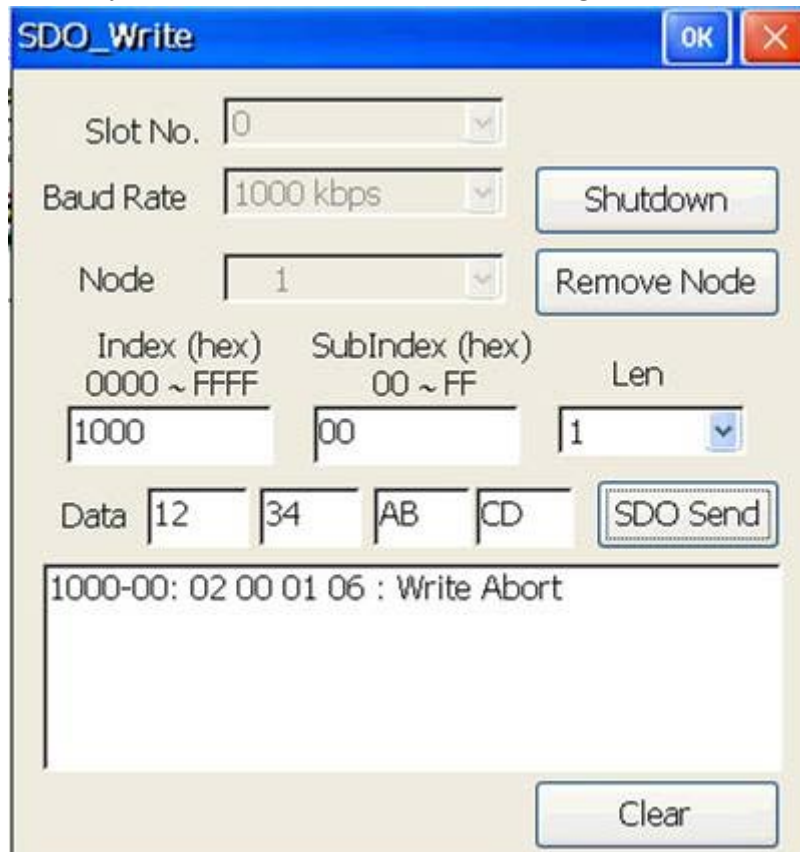


Applied function list:

[I8123_InitMaster](#), [I8123_Shutdown](#), [I8123_AddNode](#),
[I8123_RemoveNode](#), [I8123_SDOWriteData](#).

4.1.9. SYNC_Protocol

SYNC protocol is a synchronous function of the PDO communication. It is always used with the transmission type of the PDO communication. In this demo, users can know how to use the SYNC related functions.

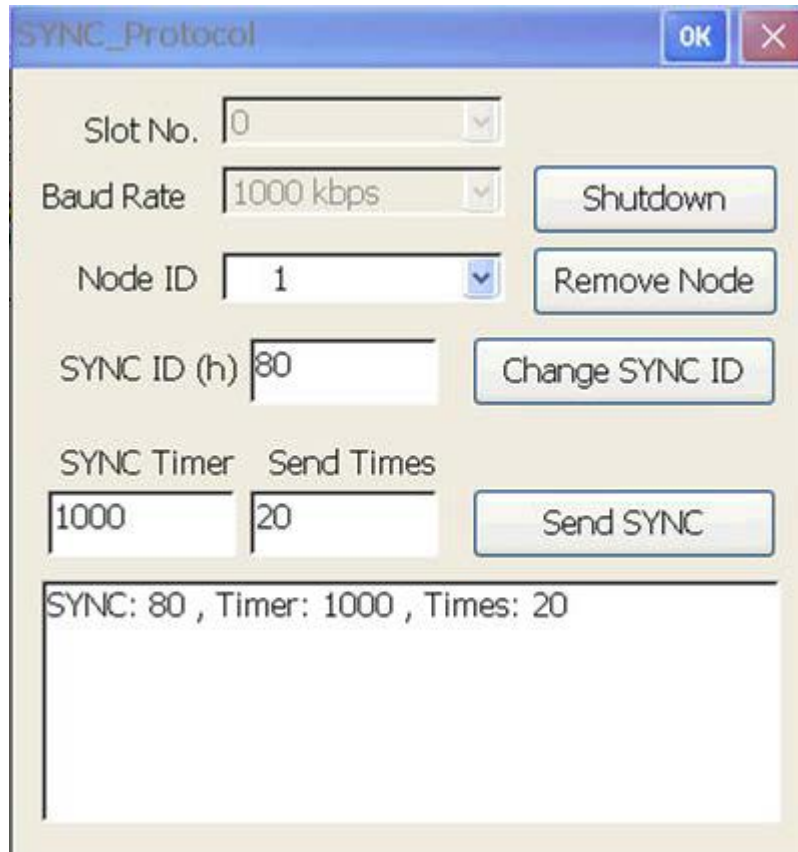


Applied function list:

[I8123_InitMaster](#), [I8123_Shutdown](#), [I8123_AddNode](#),
[I8123_RemoveNode](#), [I8123_ChangeSYNCID](#), [I8123_GetSYNCID](#),
[I8123_SendSYNCMsg](#), [I8123_GetCyclicSYNCInfo](#).

4.1.10. PDO_MultiData

Sometimes, users want to poll several PDO objects data at the same time for increasing the performance. But it is slower that sending the Remote PDO to poll each PDO data one by one. So users can set event timer or remote list for these PDO. When the PDO data are polled by the I-8123W/I-9123 or are replied from slave automatically, then use the I8123_GetMultiPDOData function to obtain these PDO data from the buffer at the same time.

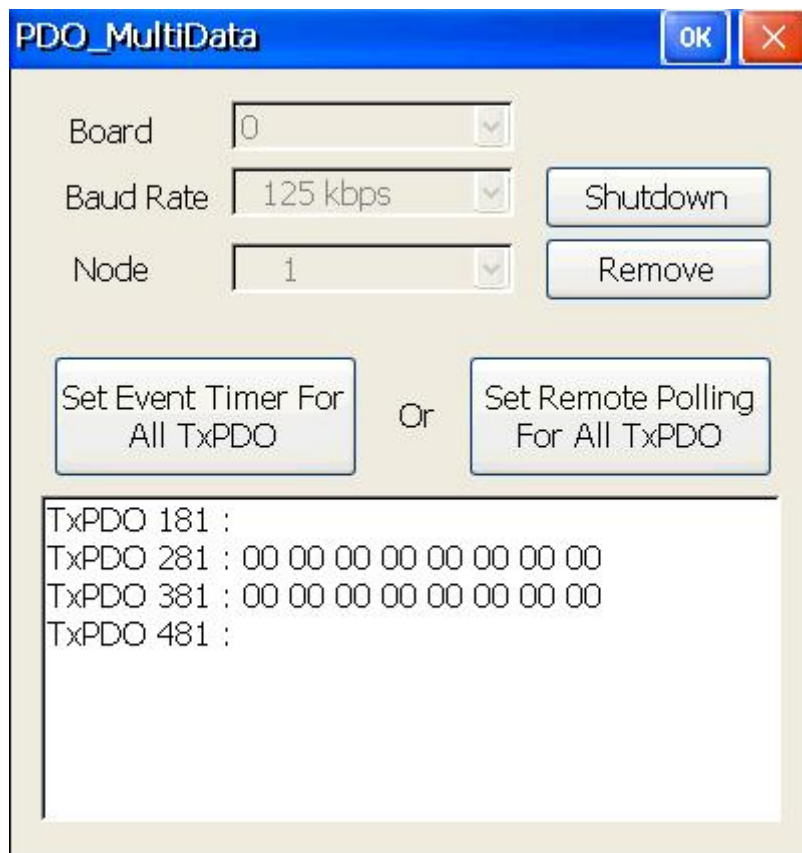

Applied function list:

[I8123_InitMaster](#), [I8123_Shutdown](#), [I8123_AddNode](#),
[I8123_RemoveNode](#), [I8123_GetTxPDOID](#), [I8123_SetPDORemotePolling](#),
[I8123_PDODEventTimer](#), [I8123_GetMultiPDOData](#)

5. Update Firmware


If users want to update the firmware of the I-8123W/I-9123, use the I-8120W utility to do it.

* Where to find the I-8120W utility?


The address of the web site:

<https://www.icpdas.com/en/download/show.php?num=1782&model=I-8123W-G>


The following steps describe the method about how to update the I-8123W/I-9123 firmware by I-8120W utility. First change the JP1 on the I-8123W/I-9123 PCI board to short pin 2 and 3 to unlock flash. Then copy the I-8120W utility on to MCU, choose the proper No. of the slot which the I-8123W/I-9123 has been plugged in. Then click the “Update Firmware” button.

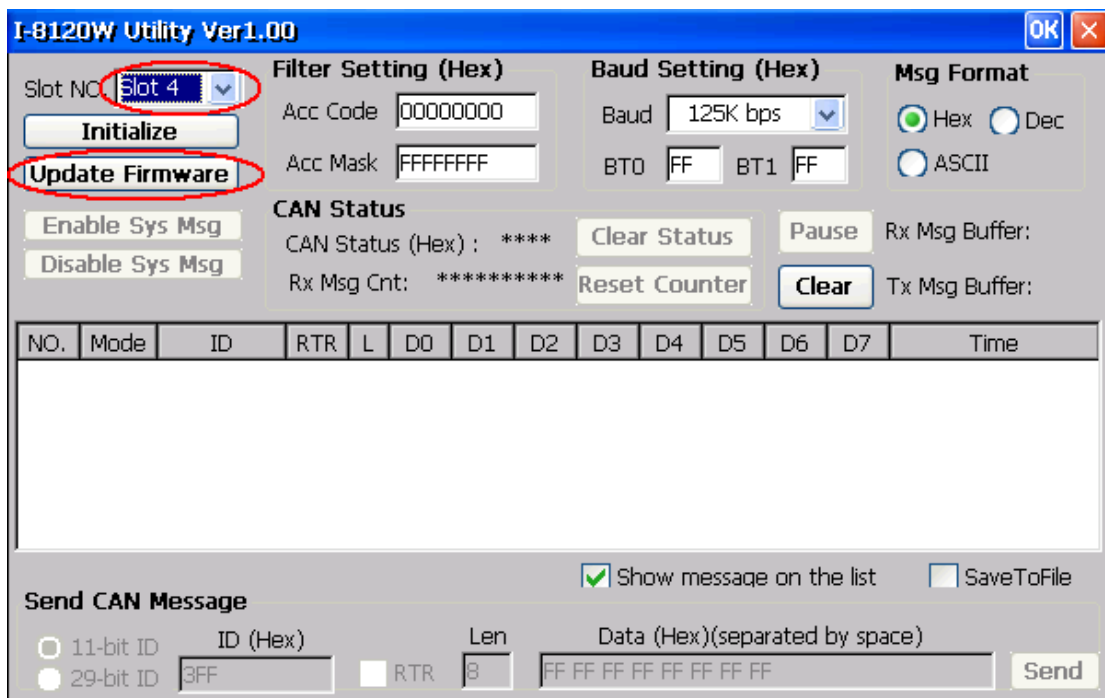

The download dialog will be popped up. Users can see the firmware name, modified date, and file size of the firmware stored in the I-8123W/I-9123. Then click “Update” button to continue.

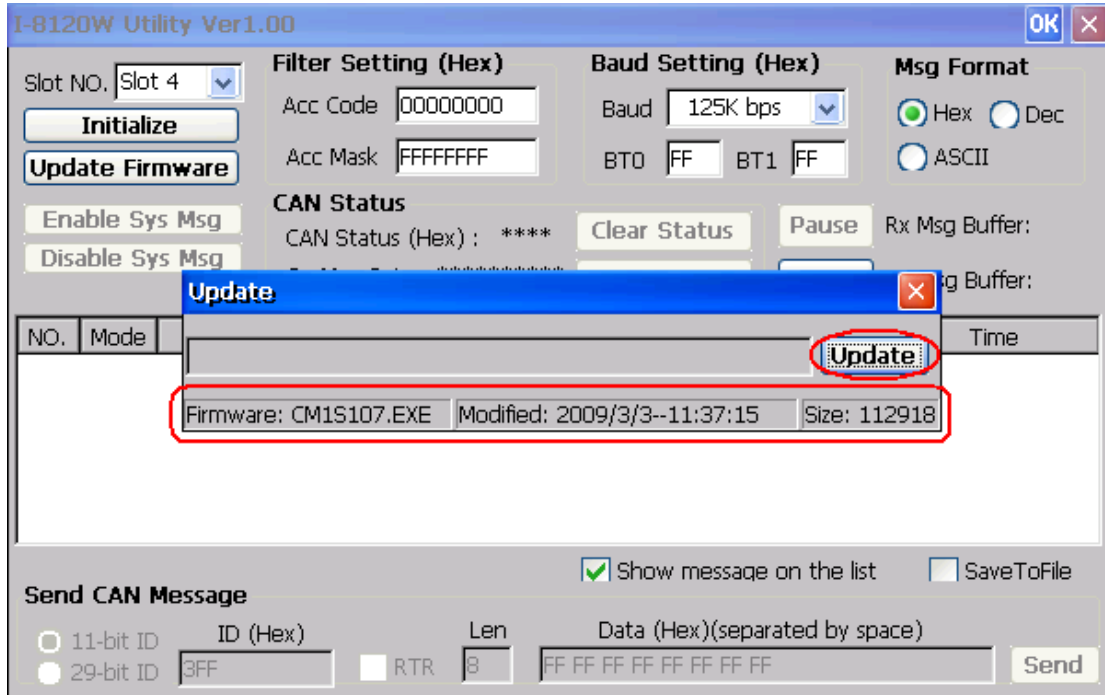

In the browser, select the file which you want to download. Then click “OK” button to go on the download procedure. Take a note that when users click “OK” button, the download procedure will be started. The original firmware stored in the I-8123W/I-9123 will be killed.

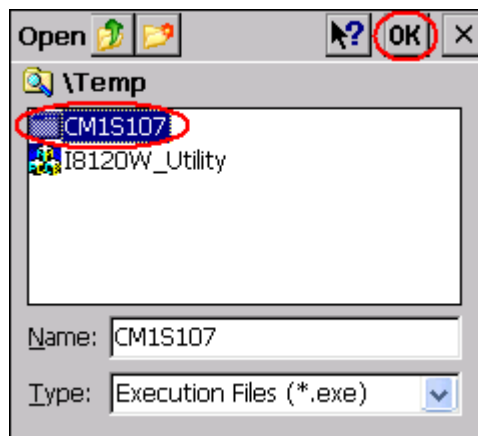

When the procedure is finished, users can see the present firmware information of the I-8123W/I-9123. Click “OK” button to close the download dialog. Afterwards, the new firmware will be run automatically. After updating the firmware, it is recommended to adjust JP1 back to the “Flash Lock” position.

